



INSTALLATION OF TWO WAY VALVE KIT FOR TWO PIPE CONNECTION

CONTENT OF VALVE KIT BOX (E2V2VN01V3WA)		
Symbol	Description	Quantity
KA	Water Pipe Assy	1
KB	Motor Operated Valve Body	1
KC	Motor Operated Valve	1
KD	Thermal Insulation	1

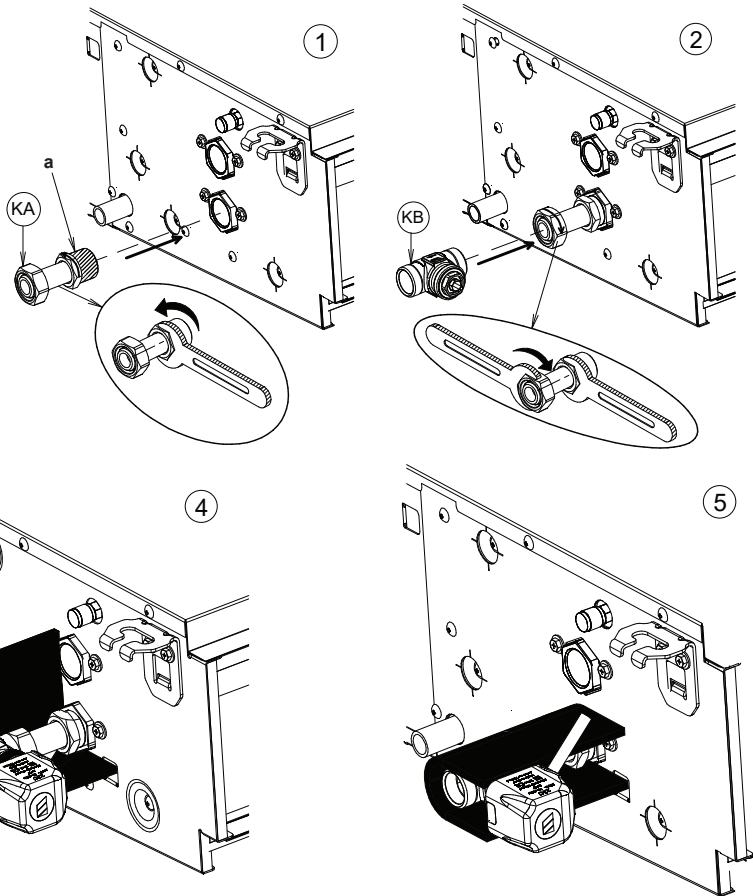

FOR FOUR PIPE CONNECTION

CONTENT OF VALVE KIT BOX (E2V4VN01V3WA)		
Symbol	Description	Quantity
KA	Water Pipe Assy	2
KB	Motor Operated Valve Body	2
KC	Motor Operated Valve	2
KD	Thermal Insulation	2

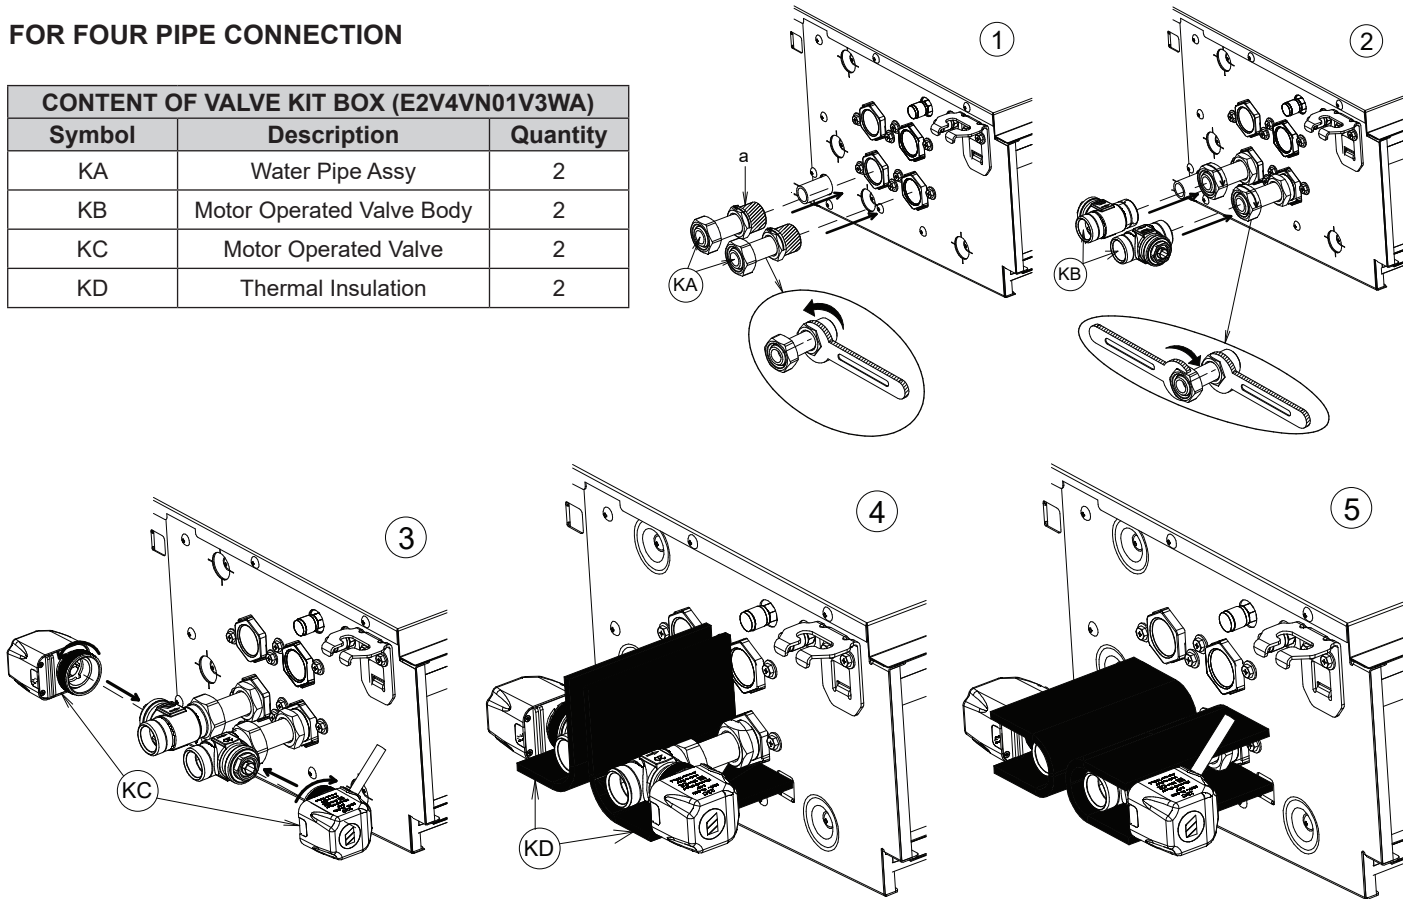

- NOTES:**
- 1) Apply sealing tape to (KA), sealing tape is field supply.
 - 2) Refer to the installation manual of (KC) about electrical wiring.


INSTALLATION OF THREE WAY VALVE KIT

FOR TWO PIPE CONNECTION




Scan and
find out
more

CONTENT OF VALVE KIT BOX (E3V2VN02V3WA)		
Symbol	Description	Quantity
KA	Water Pipe Assy	2
KB	Motor Operated Valve Body	1
KC	Motor Operated Valve	1
KD	Thermal Insulation	1

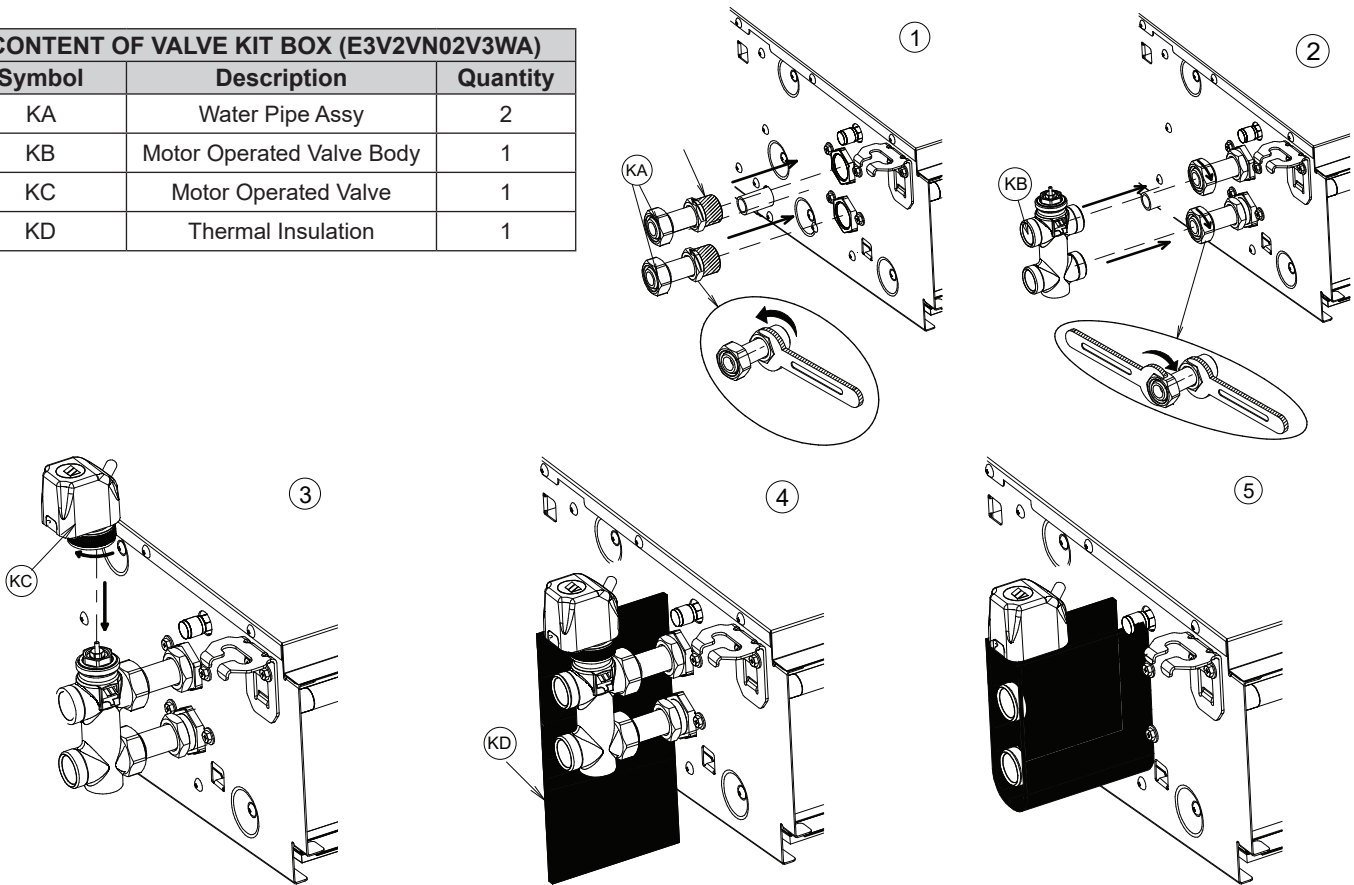

FOR FOUR PIPE CONNECTION

CONTENT OF VALVE KIT BOX (E3V4VN02V3WA)		
Symbol	Description	Quantity
KA	Water Pipe Assy	4
KB	Motor Operated Valve Body	2
KC	Motor Operated Valve	2
KD	Thermal Insulation	2

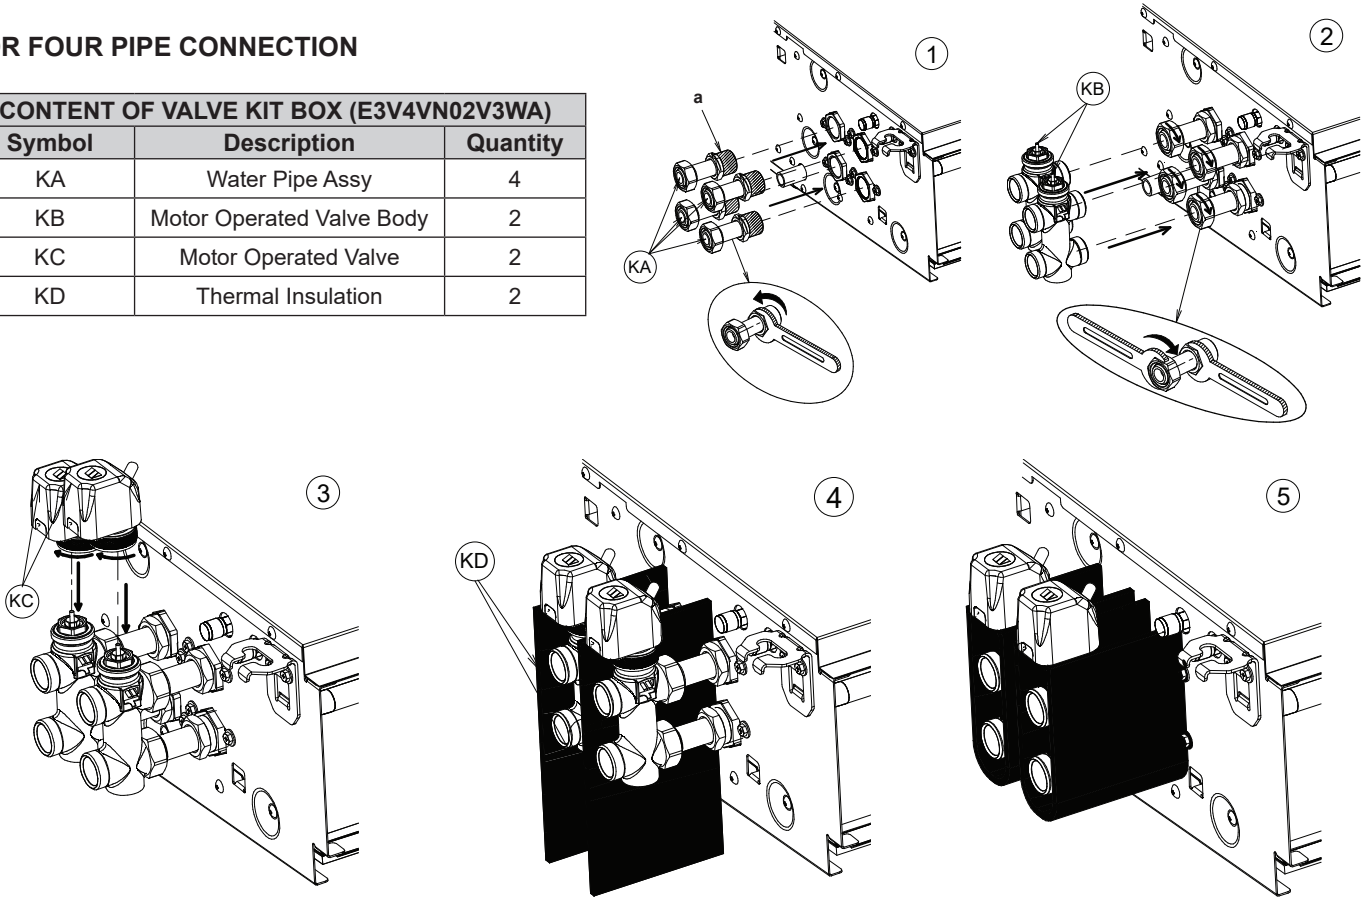

NOTES:

- 1) Apply sealing tape to (KA), sealing tape is field supply.
- 2) Refer to the installation manual of (KC) about electrical wiring.