

Air Conditioning Technical Data

UATYQ-CY1



> UATYQ250MCY17
> UATYQ350MCY17
> UATYQ450MCY17
> UATYQ550MCY17
> UATYQ600MCY17
> UATYQ700MCY17

> UATYQ900MCY17

TABLE OF CONTENTS

UATYQ-CY1

1	Features	2
2	Specifications	3
	Technical Specifications	3
	Electrical Specifications	3
3	Nomenclature	5
4	Safety device settings	6
5	Options	8
6	Selection procedure	9
7	Capacity tables	15
	Cooling Capacity Tables	15
	Heating Capacity Tables	22
	Capacity Correction Factor	24
8	Dimensional drawings	25
9	Piping diagrams	31
10	Wiring diagrams	32
	Wiring Diagrams - Single Phase	32
	Wiring Diagrams - Three Phase	33
11	Sound data	36
	Sound Level Data	36
	Sound Pressure Spectrum	37
12	Fan characteristics	41
13	Installation	43
	Roofcurb	43
	Pulley	44
14	Operation range	46
15	Specification text	47

1 Features

- Easy to install 'plug and play' concept plus single installation configuration; no additional piping is required since indoor and outdoor sides are pre-connected
- High efficiency and reliable scroll compressor
- Wide operating range
- Flat top unit design allows maximum use of warehouse and container space
- Free cooling and fresh air intake possible with optional economiser
- Convertible return and supply air: fan can be mounted in two directions
- Factory pre-charged refrigerant ensures clean and efficient operation
- Belt driven fan enables air volume and static pressure to be adjusted as required.
- Adjustable fan pulley as standard to meet a wide range of supply air volumes and external static pressures
- Anti-corrosion treated coil



2 Specifications

2-1 Technical Specifications					UATYQ250C Y1	UATYQ350C Y1	UATYQ450C Y1	UATYQ550C Y1	UATYQ600C Y1	UATYQ700C Y1	UATYQ900C Y1	
Cooling capacity	Nom.			kW	27.340 (1)	35.580 (1)	44.720 (1)	55.690 (1)	66.820 (1)	72.600 (1)	90.000 (1)	
				Btu/h	93,300 (2)	121,400 (2)	152,600 (2)	190,000 (2)	228,000 (2)	247,700 (2)	307,100 (2)	
Heating capacity	Nom.			kW	24.910 (1)	34.790 (1)	41.790 (1)	53.930 (1)	61.690 (1)	69.610 (1)	87.896 (1)	
				Btu/h	85,000 (2)	118,700 (2)	142,600 (2)	184,000 (2)	210,500 (2)	237,500 (2)	299,900 (2)	
Power input	Cooling	Nom.	kW	8.140	10.780	13.040	16.740	19.650	21.610	28.5		
	Heating	Nom.	kW	7.330	10.840	12.860	15.540	18.580	21.420	27.9		
EER					3.36	3.30	3.43	3.33	3.40	3.36	3.16	
COP					3.40	3.21	3.25	3.47	3.32	3.25	3.15	
Evaporator	Control	Air discharge			Ducted							
		Operation			Wired							
	Air flow rate	Cooling	m³/min	93.6	121.8	160.2	189.6	206.7	235.02	271.86		
	External static pressure		Pa	147				206				
	Specifications	Rows	Quantity	3			4					
		Face area	m²	0.80	0.46	0.51	0.61	0.76	0.91			
	Casing	Colour			-							Light grey
Evaporator piping connections	Condensation drain size	OD	mm	25.4								
Condenser	Dimensions	Unit	Height	mm	1,150	1,028	1,130	1,048	1,302	1,454		
			Width	mm	1,638	2,209						
			Depth	mm	2,063	2,113			2,670			
		Packin g	Height	mm	1,365	1,197	1,287	1,267	1,518	1,672		
			Width	mm	1,730	2,276						
			Depth	mm	2,293	2,344			2,901			
	Weight	Unit	kg	445	580	610	830	880	1,020			
	Casing	Colour			Ivory white							
	Heat exchanger	Rows	Quantity	2	3							
		Face area	m²	1.28	1.10	1.24	1.33	1.75	2.00			
	Air flow rate	Cooling	m³/min	203.40	339.84	342.60	365.40	572.04	600.36			
			cfm	8,230	12,000	12,100	12,900	20,200	21,200			
	Motor	Output	W	780	1,100	1,020	1,180	2,000				
	Compressor	Quantity		1	2							
		Motor	Type	Scroll								
	Operation range	Cooling	Min.	°CDB	0							
			Max.	°CDB	52							
		Heating	Min.	°CWB	-15							
			Max.	°CWB	18							
	Sound pressure level	Nom.	dBA	68	64	65	68	70				
	Sound power level	Nom.	dBA	82	83			87	90			
	Refrigerant	Type		R-410A								
		GWP		2,087.5								
		Charge	TCO ₂ eq	12.7	12.1	15	18.2	21.7	24.2			
			kg	6.1	5.8	7.2	8.7	10.4	11.6			
		Control		Electronic expansion valve								
		Circuits	Quantity	1	2							
	Refrigerant oil	Charged volume		l	-							3
	Safety devices	Item	01	High pressure switch / Low pressure switch / Phase sequencer / Discharge thermostat setting								

2-2 Electrical Specifications					UATYQ250C Y1	UATYQ350C Y1	UATYQ450C Y1	UATYQ550C Y1	UATYQ600C Y1	UATYQ700C Y1	UATYQ900C Y1
Power supply	Name				Y1						
	Phase				3~						
	Frequency			Hz	50						
	Voltage			V	380-415						
Current	Nominal running current (RLA)	Cooling	A		14.70	19.50	23.80	30.20	33.80	39.00	54.8
		Heating	A		14.10	19.80	24.40	28.80	32.30	40.20	56.7

2 Specifications

Notes

(1) Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB, 24°CWB

(2) Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB

All specifications are subjected to change by the manufacturer without prior notice.

All units are being tested and comply to ISO5151.


Sound pressure levels are measured according to JIS B 8616 standard

All performance calculations are strictly according to Eurovent standard

Contains fluorinated greenhouse gases

3 Nomenclature

3 - 1 Nomenclature

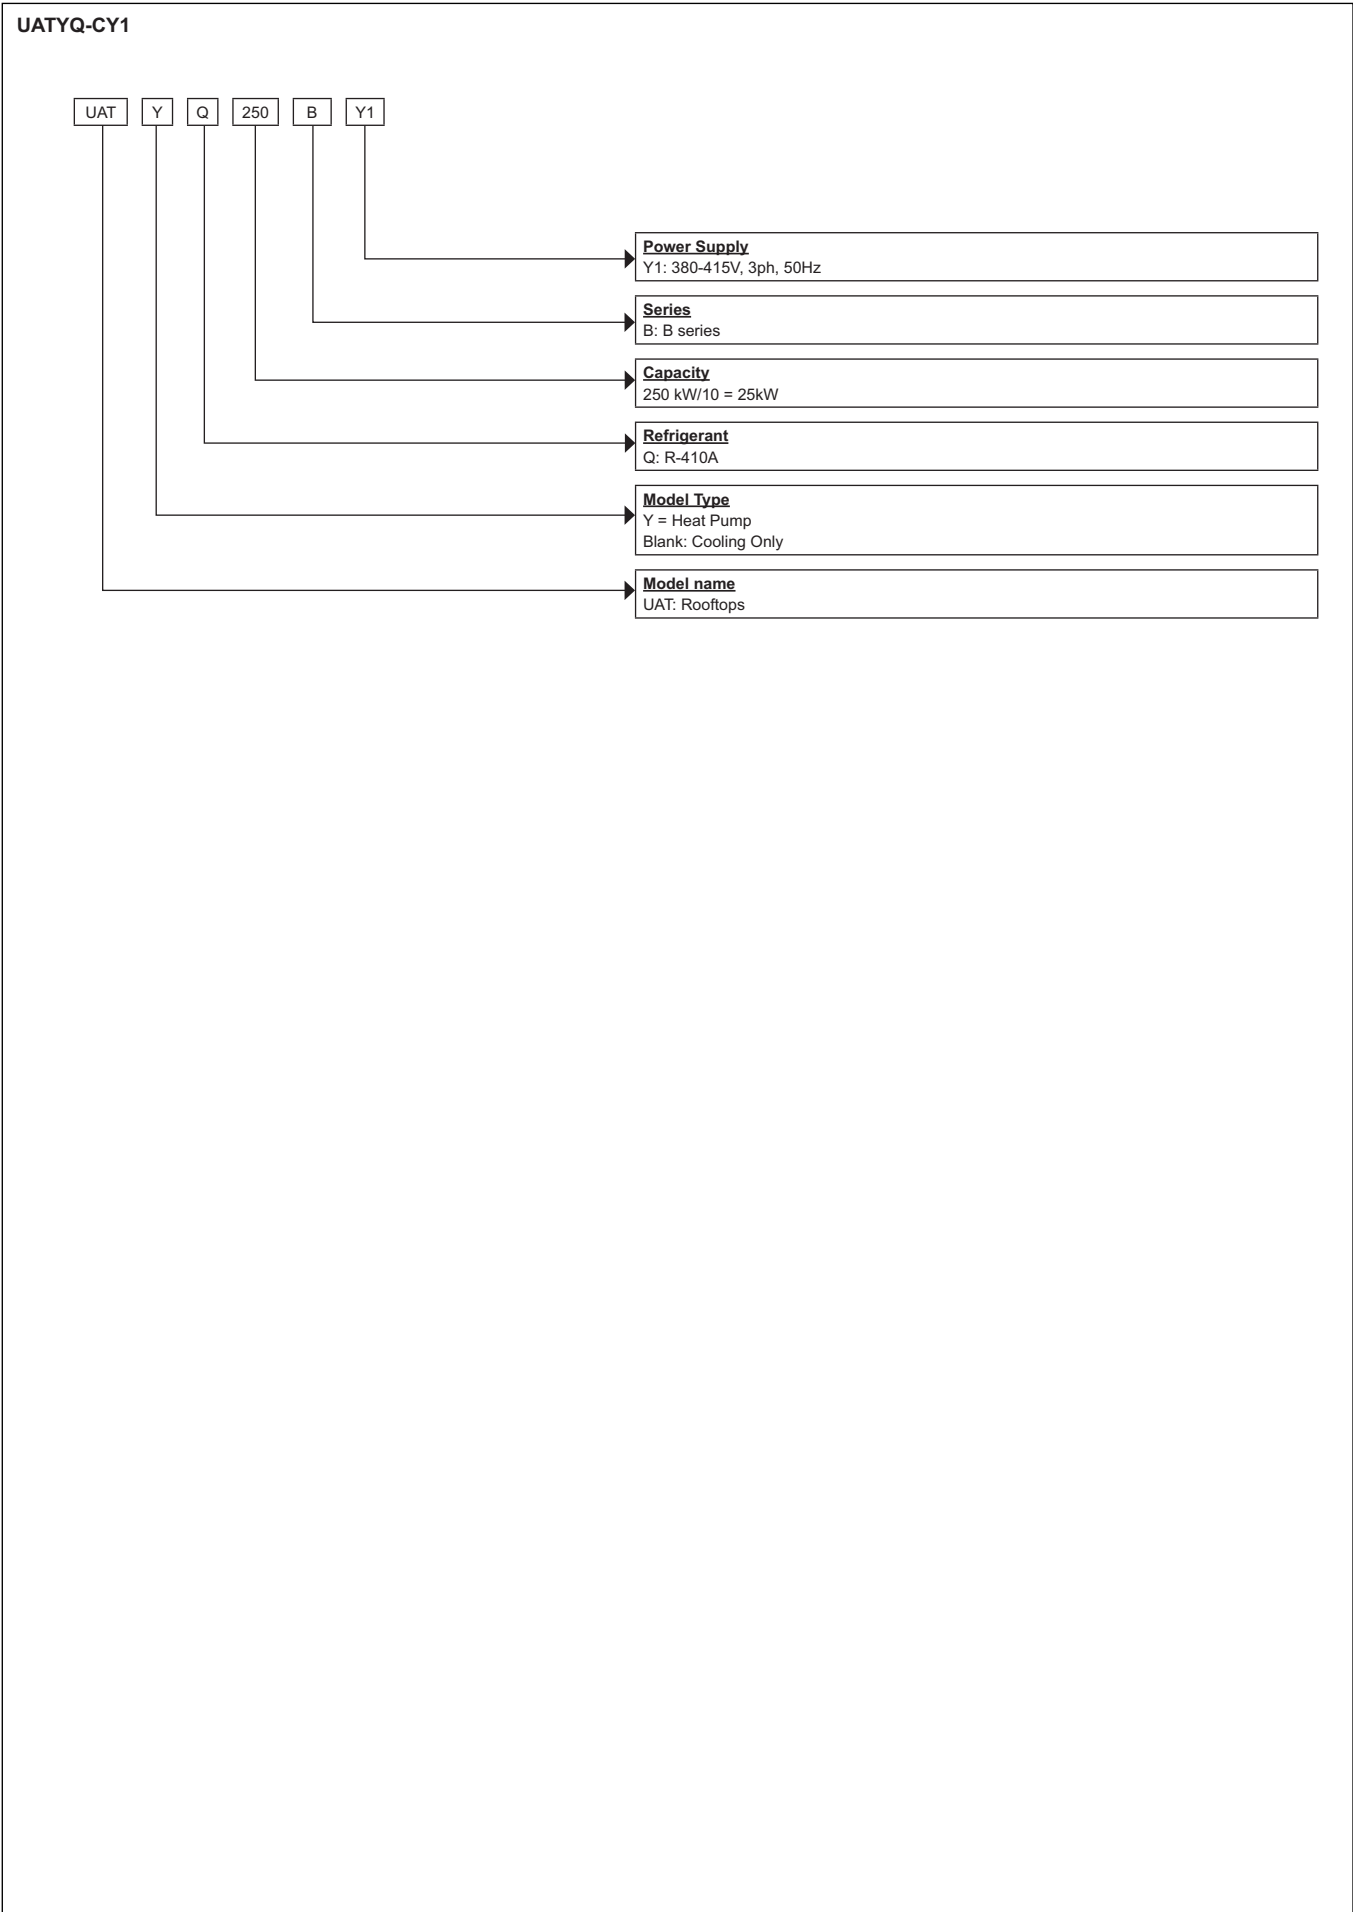

4 Safety device settings

4 - 1 Safety Device Settings

4

UATYQ250-350CY1

Model			UATYQ250CY1	UATYQ350CY1
Safety device	High pressure switch	Type	NC, Auto Reset	
		Open kPa/psi	4137 / 600	
		Close kPa/psi	3309 / 480	
	Low pressure switch	Type	NC, Auto Reset	
		Open kPa/psi	124 / 18	
		Close kPa/psi	193 / 28	
	Phase sequencer		YES	
	Discharge thermostat setting		°C/°F 120 / 248	

UATYQ450-550CY1

Model			UATYQ450CY1	UATYQ550CY1
Safety device	High pressure switch	Type	NC, Auto Reset	
		Open kPa/psi	4137 / 600	
		Close kPa/psi	3309 / 480	
	Low pressure switch	Type	NC, Auto Reset	
		Open kPa/psi	124 / 18	
		Close kPa/psi	193 / 28	
	Phase sequencer		YES	
	Discharge Thermostat setting		°C/°F 120 / 248	

4 Safety device settings

4 - 1 Safety Device Settings

UATYQ600-700CY1

Model			UATYQ600CY1		UATYQ700CY1	
Safety device	High pressure switch	Type		NC, Auto Reset		
		Open	kPa/psi	4137 / 600		
		Close	kPa/psi	3309 / 480		
	Low pressure switch	Type		NC, Auto Reset		
		Open	kPa/psi	124 / 18		
		Close	kPa/psi	193 / 28		
	Phase sequencer			YES		
	Discharge thermostat setting		°C/°F	120 / 248		

UATYQ900CY1

Model			UATYQ900CY1	
High Pressure Switch	Type		NC, Auto Reset	
	Open	kPa / psi	4137	600
	Close	kPa / psi	3309	480
Low Pressure Switch	Type		NC, Auto Reset	
	Open	kPa / psi	124	18
	Close	kPa / psi	193	28
Phase Sequencer			PP1.03 w/o sensor	
Discharge Thermostat Setting		°C	120	

5 Options

5 - 1 Options

5

UATYQ-CY1

Model		Classification										
		Rooftop controller	PCB	EXV	Gold Fin (NA549)	Scroll compressor	Saranet Air Filter	Side flow	Convertible	Filter Drier	High pressure switch	Low pressure switch
UATYQ-CY1	250	X	X	X	X	X	X	X	X	X	X	X
	350	X	X	X	X	X	X	X	X	X	X	X
	450	X	X	X	X	X	X	X	X	X	X	X
	550	X	X	X	X	X	X	X	X	X	X	X
	600	X	X	X	X	X	X	X	X	X	X	X
	700	X	X	X	X	X	X	X	X	X	X	X
	900	X	X	X	X	X	X	X	X	X	X	X

Remarks: Economisers & CO₂ sensor will be ready soon.

6 Selection procedure

6 - 1 Selection Procedure

Calculation Steps

Interpolation method can be used to get the total capacity, TC and sensible capacity, SC and power input, PI at those temperatures which are not stated out in the table. Extrapolation method are not allowed to be used to get the TC, SC and PI.

Example:

Model: UATYQ450BY1

Indoor Condition: 25°C DB, 17°C WB

Outdoor Condition: 37°C DB

Fan Speed: High (5650CFM)


Solution:

Overall

Based on the Performance Table

1. Refer to the Indoor DB column,
 - **25°C** is located between 24°C and 27°C for 16°CWB (Thus, Interpolation need to be applied)
 - **25°C** is located between 24°C and 27°C for 19°CWB (Thus, Interpolation need to be applied)
2. Refer to the Indoor WB column,
 - **17°C** is located between 16°CWB and 19°CWB for 25°CDB (Thus, Interpolation need to be applied)
3. Refer to the Outdoor DB column,
 - **37°C** is located between 35°C and 40°C. (Thus, Interpolation need to be applied)

Please follow the steps below in order to get the required capacity.

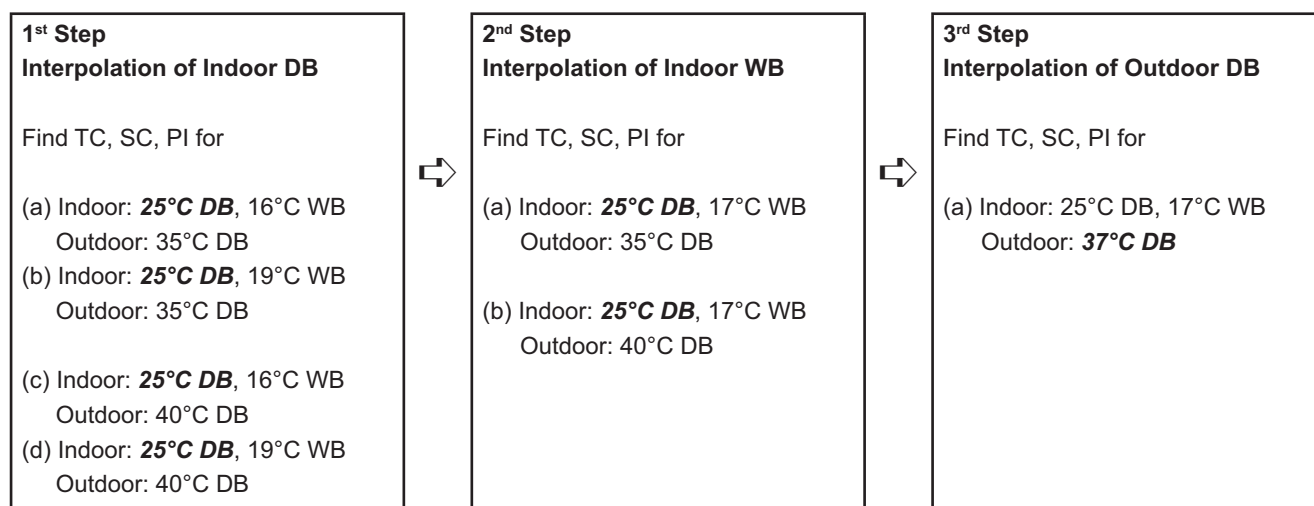

6 Selection procedure

6 - 1 Selection Procedure

6

Details:

1st Step:

To obtain the Total capacity and Sensible capacity and Power input for

(a) Indoor Condition: **25°C DB**, 16°C WB

Outdoor Condition: 35°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C			
		35			
			TC (kW)	SHC (kW)	PI (kW)
16					
	24		41.41	35.59	12.81
	25		X ₁	Y ₁	Z ₁
	27		43.48	41.63	12.94

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{43.48\text{kW} - 41.41\text{kW}}{43.48\text{kW} - x_1\text{kW}}$$

$$\Rightarrow x_1 = 42.10\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{41.63\text{kW} - 35.59\text{kW}}{43.48\text{kW} - y_1\text{kW}}$$

$$\Rightarrow y_1 = 37.60\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{27^{\circ}\text{C} - 24^{\circ}\text{C}}{27^{\circ}\text{C} - 25^{\circ}\text{C}} = \frac{12.94\text{kW} - 12.81\text{kW}}{12.94\text{kW} - z_1\text{kW}}$$

$$\Rightarrow z_1 = 12.85\text{kW}$$

6 Selection procedure

6 - 1 Selection Procedure

(b) Indoor Condition: 25°C DB, 16°C WB

Outdoor Condition: 40°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C			
			40		
			TC (kW)	SHC (kW)	PI (kW)
16					
	24		38.59	33.52	13.91
	25		X ₂	Y ₂	Z ₂
	27		40.74	39.20	14.06

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{27^\circ \text{C} - 24^\circ \text{C}}{27^\circ \text{C} - 25^\circ \text{C}} = \frac{43.48\text{kW} - 41.41\text{kW}}{40.74\text{kW} - x_2\text{kW}}$$

$$\Rightarrow x_2 = 39.31\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{27^\circ \text{C} - 24^\circ \text{C}}{27^\circ \text{C} - 25^\circ \text{C}} = \frac{39.20\text{kW} - 33.52\text{kW}}{39.20\text{kW} - y_2\text{kW}}$$

$$\Rightarrow y_2 = 35.41\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{27^\circ \text{C} - 24^\circ \text{C}}{27^\circ \text{C} - 25^\circ \text{C}} = \frac{14.06\text{kW} - 13.91\text{kW}}{14.06\text{kW} - z_2\text{kW}}$$

$$\Rightarrow z_2 = 13.96\text{kW}$$

* Repeat process (a) and (b) in 1st step for the condition below:

(c) Indoor Condition: 25°C DB, 19°C WB

Outdoor Condition: 35°C DB

$$\Rightarrow x_3 = 44.55\text{kW}$$

$$\Rightarrow y_3 = 31.63\text{kW}$$

$$\Rightarrow z_3 = 13.03\text{kW}$$

(c) Indoor Condition: 25°C DB, 19°C WB

Outdoor Condition: 40°C DB

$$\Rightarrow x_4 = 41.46\text{kW}$$

$$\Rightarrow y_4 = 31.63\text{kW}$$

$$\Rightarrow z_4 = 14.13\text{kW}$$

6 Selection procedure

6 - 1 Selection Procedure

6

2nd Step:

To obtain the Total capacity, Sensible capacity and Power Input for

(a) Indoor Condition: 25°C DB, 17°C WB

Outdoor Condition: 35°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C			
		35			
			TC (kW)	SHC (kW)	PI (kW)
			⋮	⋮	
16	25		42.10	37.60	12.85
17			X ₅	Y ₅	Z ₅
19			44.55	31.63	13.03

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{44.55\text{kW} - 42.10\text{kW}}{44.55\text{kW} - x_5\text{kW}}$$

$$\Rightarrow x_5 = 42.92\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{31.63\text{kW} - 37.60\text{kW}}{31.63\text{kW} - y_5\text{kW}}$$

$$\Rightarrow y_5 = 35.61\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{13.03\text{kW} - 12.85\text{kW}}{13.03\text{kW} - z_5\text{kW}}$$

$$\Rightarrow z_5 = 12.91\text{kW}$$

6 Selection procedure

6 - 1 Selection Procedure

(b) Indoor Condition: 25°C DB, 17°C WB

Outdoor Condition: 40°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C			
			40		
			TC (kW)	SHC (kW)	PI (kW)
			⋮	⋮	
16	25		39.31	35.41	13.96
17			X ₆	Y ₆	Z ₆
19			41.46	29.99	14.13

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{41.46\text{kW} - 39.31\text{kW}}{41.46\text{kW} - x_6\text{kW}}$$

$$\Rightarrow x_6 = 40.03\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{29.99\text{kW} - 35.41\text{kW}}{29.99\text{kW} - y_6\text{kW}}$$

$$\Rightarrow y_6 = 33.60\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{19^{\circ}\text{C} - 16^{\circ}\text{C}}{19^{\circ}\text{C} - 17^{\circ}\text{C}} = \frac{14.13\text{kW} - 13.96\text{kW}}{14.13\text{kW} - z_6\text{kW}}$$

$$\Rightarrow z_6 = 14.02\text{kW}$$

6 Selection procedure

6 - 1 Selection Procedure

6

3rd Step:

To obtain the Total capacity and Sensible capacity for

(a) **Indoor Condition:** 25°C DB, 17°C WB

Outdoor Condition: 37°C DB

Indoor WB °C	Indoor DB °C	Outdoor DB, °C									
			35			35			40		
			TC (kW)	SHC (kW)	PI (kW)	TC (kW)	SHC (kW)	PI (kW)	TC (kW)	SHC (kW)	PI (kW)
25	17		42.92	35.61	12.61	x	y	z	40.03	33.60	14.02

Total capacity, TC

Interpolation Method:

$$\Rightarrow \frac{40^\circ \text{C} - 35^\circ \text{C}}{40^\circ \text{C} - 37^\circ \text{C}} = \frac{40.03\text{kW} - 42.92\text{kW}}{40.03\text{kW} - x\text{kW}}$$

$$\Rightarrow x = 41.76\text{kW}$$

Sensible capacity, SHC

Interpolation Method:

$$\Rightarrow \frac{40^\circ \text{C} - 35^\circ \text{C}}{40^\circ \text{C} - 37^\circ \text{C}} = \frac{33.60\text{kW} - 35.61\text{kW}}{33.60\text{kW} - y\text{kW}}$$

$$\Rightarrow y = 34.81\text{kW}$$

Power Input, PI

Interpolation Method:

$$\Rightarrow \frac{40^\circ \text{C} - 35^\circ \text{C}}{40^\circ \text{C} - 37^\circ \text{C}} = \frac{14.02\text{kW} - 12.91\text{kW}}{14.02\text{kW} - z\text{kW}}$$

$$\Rightarrow z = 13.35\text{kW}$$

Capacity tables

7 - 1 Cooling Capacity Tables

UATYQ250CY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
2640	16°C	21°C	26.92	17.79	6.55	25.90	17.33	6.93	25.31	17.19	7.46	24.12	16.64	7.91	22.42	15.75	8.60	50.86	15.04	9.52
		24°C	27.02	20.73	6.56	26.00	20.27	6.94	25.41	20.17	7.47	24.23	19.64	7.92	22.60	18.55	8.61	21.16	17.59	9.54
		28°C	27.60	25.41	6.58	26.65	24.72	6.97	26.15	24.48	7.51	25.07	26.64	7.97	23.52	22.40	8.67	22.18	21.23	9.62
		30°C	28.31	28.31	28.31	6.65	27.43	27.43	7.05	26.49	7.60	25.49	25.49	8.08	23.92	23.92	8.78	22.61	22.61	9.72
	19°C	24°C	29.44	16.79	6.69	28.30	16.35	7.08	27.67	16.22	7.61	26.39	15.74	8.07	24.56	14.94	8.76	22.90	14.29	9.68
		27°C	29.52	20.66	6.70	28.39	20.20	7.09	27.75	20.12	7.62	26.48	19.60	8.08	24.65	18.68	8.76	23.00	18.02	9.59
		30°C	29.67	24.23	6.71	28.66	23.57	7.10	28.13	23.34	7.64	26.94	22.58	8.11	25.20	21.36	8.80	23.69	20.39	9.74
		33°C	30.23	30.23	6.75	28.93	28.93	7.15	29.12	29.12	7.71	28.05	28.05	8.18	25.58	25.58	8.89	24.48	24.48	9.84
	22°C	27°C	31.94	16.47	6.85	30.87	16.13	7.25	30.19	16.01	7.79	28.81	15.54	8.25	26.84	14.76	8.93	25.10	14.19	9.86
		30°C	32.17	20.48	6.86	30.94	20.03	7.25	30.25	19.95	7.79	28.89	19.46	8.25	26.91	18.57	8.94	25.16	17.95	9.86
		33°C	32.25	24.19	6.86	31.02	23.73	7.26	30.32	23.72	7.80	28.97	23.22	8.26	27.10	21.99	8.96	25.53	21.02	9.89
		36°C	32.40	26.87	6.89	31.28	26.17	7.29	30.91	26.12	7.84	29.66	25.35	8.31	27.94	24.19	9.02	26.43	23.19	9.96
3300	16°C	21°C	27.89	18.62	6.60	26.78	18.12	6.98	26.14	17.97	7.51	24.90	17.42	7.97	23.11	16.51	8.65	21.47	15.80	9.57
		24°C	28.06	22.96	6.62	27.05	22.29	7.00	26.49	22.00	7.54	25.32	21.22	7.99	23.59	19.99	8.68	22.07	18.98	9.61
		28°C	29.12	26.80	6.67	28.17	26.05	7.07	27.69	25.74	7.61	26.58	24.83	8.08	24.90	23.38	8.78	23.45	22.13	9.72
		30°C	30.19	30.19	6.77	29.19	29.19	7.17	28.15	28.15	7.72	27.06	27.06	8.20	25.10	25.10	8.90	23.69	23.69	9.84
	19°C	24°C	30.42	18.53	6.75	29.22	18.04	7.14	28.53	17.90	7.67	27.19	17.36	8.13	25.27	16.47	8.81	23.53	15.79	9.73
		27°C	30.57	22.98	6.76	29.37	22.49	7.15	28.69	22.42	7.68	27.34	21.87	8.14	25.50	20.72	8.83	23.88	19.68	9.76
		30°C	31.20	26.32	6.79	30.07	25.60	7.19	29.48	25.35	7.74	28.23	24.56	8.20	26.44	23.20	8.90	24.97	22.02	9.84
		33°C	31.86	31.86	6.87	30.85	30.85	7.28	29.77	29.77	7.84	28.63	28.63	8.32	26.87	26.87	9.03	25.43	25.43	9.97
	22°C	27°C	33.11	18.28	6.91	31.80	17.84	7.31	31.07	17.74	7.85	29.63	17.22	8.31	27.56	16.35	9.00	25.73	15.70	9.91
		30°C	33.22	22.84	6.92	31.92	22.36	7.32	31.19	22.30	7.86	29.75	21.77	8.32	27.69	20.80	9.01	25.88	20.15	9.92
		33°C	33.46	27.07	6.94	32.26	26.33	7.34	31.64	26.07	7.89	30.30	25.24	8.36	28.32	23.90	9.06	26.66	22.87	9.99
		36°C	34.08	29.22	6.99	32.88	28.63	7.39	32.05	28.12	7.96	30.87	27.22	8.44	28.71	25.44	9.16	26.93	23.98	10.11
3960	16°C	21°C	28.55	20.03	6.64	27.41	19.53	7.02	26.74	19.37	7.55	25.45	18.80	8.01	23.61	17.83	8.69	21.92	17.08	9.60
		24°C	29.05	24.35	6.67	27.95	23.62	7.06	27.35	23.32	7.59	26.12	22.50	8.05	24.34	21.22	8.74	22.83	20.03	9.67
		28°C	30.46	28.03	6.75	29.39	27.18	7.14	28.90	26.86	7.69	27.71	25.88	8.16	25.94	24.35	8.86	24.39	23.02	9.80
		30°C	31.28	31.28	6.85	30.22	30.22	7.26	29.11	29.11	7.82	27.95	27.95	8.29	26.31	26.31	8.99	24.55	24.55	9.93
	19°C	24°C	31.12	19.98	6.79	29.87	19.47	7.18	29.13	19.32	7.72	27.73	18.76	8.17	25.77	17.83	8.85	24.00	17.13	9.77
		27°C	31.33	25.03	6.81	30.11	24.43	7.20	29.49	24.14	7.74	28.17	23.28	8.20	26.26	21.96	8.89	24.60	20.89	9.81
		30°C	32.28	27.64	6.86	31.18	26.95	7.26	30.65	26.63	7.82	29.43	25.69	8.29	27.58	24.20	8.99	26.01	22.94	9.93
		33°C	33.03	33.03	6.97	31.95	31.95	7.38	31.12	31.12	7.94	29.92	29.92	8.42	28.06	28.06	9.13	26.23	26.23	10.07
	22°C	27°C	33.81	19.81	6.96	32.47	19.31	7.35	31.68	19.18	7.90	30.17	18.63	8.35	28.08	17.73	9.04	26.22	17.07	9.95
		30°C	34.00	24.92	6.97	32.65	24.41	7.37	31.86	24.37	7.91	30.36	23.82	8.37	28.30	22.72	9.05	26.55	21.64	9.98
		33°C	34.64	28.87	7.01	33.36	28.08	7.41	32.68	27.82	7.96	31.30	26.96	8.43	29.24	25.53	9.13	27.65	24.26	10.07
		36°C	35.21	30.28	7.08	33.71	29.13	7.50	33.22	28.86	8.08	31.96	27.90	8.56	29.70	26.06	9.27	28.12	24.80	10.22

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

1. Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
2. ■■■■■ shows nominal capacities. - ■■■■■ stellt Nennleistungen dar. - ■■■■■ υποδεικνύει ονομαστικές τιμές απόδοσης. - ■■■■■ indica capacidades nominales. - ■■■■■ indique les puissances nominales. - ■■■■■ mostra le capacità nominali. - ■■■■■ geeft nominale capaciteiten weer. - ■■■■■ показывает номинальные значения мощности. - ■■■■■ nominal kapasite değerlerini gösterir.
3. Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεκβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'estrapolazione. - Directe interpolatie is toegestaan. Extrapoler niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmayın.
4. Unit is able to operate at ambient from 0°C to 46°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 46°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 46°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 46°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 46° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 46°C zonder drukschakeling. - Блок может работать при температуре окружающей среды от 0 до 46°C без отключения, вызываемого давлением. - Ünite, 0°C ila 46°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)

EWB: Entering Wet Bulb Temp. - Eingangs-Feuchtemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)

EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)

TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)

SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)

PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

7 Capacity tables

7 - 1 Cooling Capacity Tables

7

UATYQ350CY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
3440	16°C	21°C	35.03	23.44	8.48	33.71	22.84	8.97	32.94	22.65	9.66	31.40	21.92	10.25	29.18	20.75	11.13	27.15	19.82	12.33
		24°C	35.17	27.32	8.49	33.84	26.70	8.98	33.07	26.58	9.67	31.54	25.88	10.26	29.41	24.44	11.15	27.53	23.17	12.35
		28°C	35.91	33.48	8.52	34.68	32.58	9.03	34.04	32.25	9.72	32.62	31.14	10.33	30.61	29.52	11.23	28.86	27.97	12.45
		30°C	36.85	36.85	8.62	35.70	35.70	9.13	34.47	34.47	9.84	33.17	33.17	10.46	31.13	31.13	11.37	29.42	29.42	12.59
	19°C	24°C	38.31	22.12	8.67	36.83	21.54	9.17	36.02	21.38	9.86	34.34	20.74	10.45	31.97	19.68	11.34	29.80	18.83	12.53
		27°C	38.41	27.23	8.67	36.95	26.62	9.17	36.12	26.51	9.87	34.46	25.83	10.46	32.08	24.62	11.35	29.93	23.75	12.54
		30°C	38.61	31.92	8.68	37.30	31.06	9.19	36.60	30.75	9.90	35.06	29.75	10.50	32.80	28.14	11.40	30.84	26.87	12.61
		33°C	39.34	39.34	8.74	37.65	37.65	9.26	37.89	37.89	9.98	36.50	36.50	10.60	33.28	33.28	11.51	31.86	31.86	12.74
	22°C	27°C	41.56	21.70	8.87	40.17	21.25	9.38	39.29	21.10	10.08	37.49	20.48	10.68	34.93	19.45	11.57	32.66	18.70	12.76
		30°C	41.87	26.99	8.88	40.27	26.39	9.39	39.36	26.29	10.09	37.59	25.64	10.69	35.02	24.47	11.58	32.75	23.65	12.77
		33°C	41.97	31.88	8.88	40.37	31.27	9.39	39.46	31.25	10.10	37.71	30.59	10.69	35.27	28.97	11.60	33.22	27.70	12.81
		36°C	42.16	35.40	8.92	40.71	34.49	9.44	40.22	34.41	10.16	38.60	33.40	10.77	36.36	31.87	11.68	34.39	30.55	12.90
4300	16°C	21°C	36.29	24.53	8.55	34.85	23.88	9.04	34.02	23.68	9.73	32.40	22.96	10.32	30.07	21.76	11.20	27.95	20.82	12.39
		24°C	36.52	30.25	8.57	35.20	29.37	9.06	34.48	28.99	9.76	32.95	27.97	10.35	30.70	26.34	11.24	28.72	25.01	12.44
		28°C	37.90	35.31	8.63	36.66	34.33	9.15	36.04	33.91	9.85	34.59	32.72	10.46	32.41	30.81	11.37	30.52	29.16	12.58
		30°C	39.29	39.29	8.76	37.99	37.99	9.28	36.64	36.64	10.00	35.22	35.22	10.61	32.66	32.66	11.52	30.84	30.84	12.74
	19°C	24°C	39.59	24.42	8.74	38.02	23.77	9.24	37.13	23.58	9.94	35.38	22.87	10.53	32.88	21.70	11.41	30.63	20.80	12.60
		27°C	39.78	30.28	8.75	38.22	29.63	9.26	37.33	29.54	9.95	35.58	28.82	10.54	33.19	27.31	11.43	31.08	25.94	12.63
		30°C	40.60	34.68	8.80	39.13	33.73	9.31	38.36	33.40	10.02	36.74	32.36	10.62	34.41	30.57	11.52	32.50	29.01	12.74
		33°C	41.47	41.47	8.89	40.14	40.14	9.42	38.74	38.74	10.15	37.25	37.25	10.77	34.97	34.97	11.69	33.09	33.09	12.91
	22°C	27°C	43.08	24.09	8.95	41.39	23.51	9.46	40.44	23.37	10.17	38.56	22.69	10.76	35.87	21.54	11.65	33.48	20.68	12.84
		30°C	43.24	30.09	8.96	41.54	29.46	9.47	40.59	29.39	10.18	38.72	28.69	10.77	36.04	27.41	11.66	33.68	26.54	12.85
		33°C	43.54	35.67	8.98	41.98	34.70	9.50	41.17	34.36	10.22	39.43	33.26	10.82	36.85	31.49	11.73	34.69	30.14	12.93
		36°C	44.35	38.50	9.05	42.79	37.73	9.57	41.71	37.05	10.30	40.17	35.87	10.93	37.36	33.52	11.86	35.05	31.60	13.09
5160	16°C	21°C	37.15	26.40	8.60	35.67	25.73	9.10	34.80	25.53	9.78	33.12	24.77	10.37	30.72	23.49	11.25	28.53	22.51	12.44
		24°C	37.81	32.08	8.64	36.37	31.12	9.14	35.60	30.73	9.83	33.99	29.65	10.42	31.67	27.96	11.31	29.72	26.40	12.52
		28°C	39.64	36.93	8.74	38.25	35.82	9.25	37.61	35.39	9.96	36.06	34.11	10.57	33.75	32.08	11.47	31.75	30.33	12.69
		30°C	40.70	40.70	8.88	39.33	39.33	9.40	37.89	37.89	10.12	36.38	36.38	10.73	34.24	34.24	11.64	31.95	31.95	12.86
	19°C	24°C	40.50	26.32	8.80	38.87	25.65	9.30	37.91	25.46	9.99	36.08	24.72	10.58	33.54	23.49	11.46	31.23	22.57	12.65
		27°C	40.77	32.98	8.81	39.19	32.20	9.32	38.38	31.80	10.02	36.66	30.68	10.62	34.18	28.93	11.51	32.02	27.53	12.71
		30°C	42.01	36.43	8.88	40.57	35.51	9.40	39.89	35.08	10.12	38.30	33.85	10.73	35.89	31.89	11.64	33.85	30.22	12.86
		33°C	42.99	42.99	9.02	41.59	41.59	9.55	40.50	40.50	10.28	38.94	38.94	10.90	36.52	36.52	11.82	34.14	34.14	13.04
	22°C	27°C	44.00	26.10	9.01	42.25	25.45	9.52	41.23	25.28	10.23	39.27	24.55	10.82	36.55	23.36	11.70	34.12	22.49	12.89
		30°C	44.25	32.84	9.03	42.49	32.17	9.54	41.47	32.11	10.24	39.52	31.38	10.84	36.83	29.94	11.72	34.56	28.51	12.92
		33°C	45.08	38.04	9.07	43.41	37.00	9.60	42.53	36.65	10.31	40.73	35.53	10.92	38.05	33.64	11.82	35.98	31.96	13.04
		36°C	45.82	39.90	9.17	43.87	38.39	9.72	43.23	38.03	10.46	41.59	36.77	11.08	38.65	34.34	12.00	36.60	32.68	13.24

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεκβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'extrapolazione. - Directe interpolatie is toegestaan. Extrapoleren niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmamasına izin verilir. Ekstrapolasyon yapılmayın.
- Unit is able to operate at ambient from 0°C to 46°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 46°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 46°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 46°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 46° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 46°C zonder drukuitschakeling. - Блок может работать при температуре окружающей среды от 0 до 46°C без отключения, вызываемого давлением. - Ünite, 0°C ila 46°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

- AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)
- EWB: Entering Wet Bulb Temp. - Eingangs-Feuchtemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)
- EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)
- TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)
- SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αίσθητης θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)
- PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

Capacity tables

7 - 1 Cooling Capacity Tables

7

UATYQ450CY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
4520	16°C	21°C	44.03	29.82	10.49	42.37	29.06	11.10	41.41	28.82	11.95	39.46	27.89	12.68	36.67	26.40	13.77	34.12	25.22	15.25
		24°C	44.20	34.76	10.50	42.53	33.98	11.11	41.57	33.82	11.96	39.64	32.93	12.69	36.97	31.10	13.79	34.60	29.48	15.28
		28°C	45.14	42.60	10.55	43.59	41.45	11.17	42.78	41.04	12.03	41.00	39.63	12.77	38.48	37.56	13.89	36.28	35.59	15.40
		30°C	46.31	46.31	10.66	44.87	44.87	11.30	43.33	43.33	12.18	41.69	41.69	12.94	39.13	39.13	14.06	36.98	36.98	15.58
	19°C	24°C	48.15	28.14	10.72	46.29	27.41	11.34	45.27	27.20	12.20	43.16	26.39	12.93	40.18	25.04	14.03	37.46	23.96	15.50
		27°C	48.28	34.64	10.73	46.44	33.87	11.35	45.40	33.74	12.21	43.31	32.87	12.94	40.32	31.33	14.04	37.62	30.22	15.52
		30°C	48.53	40.62	10.74	46.88	39.53	11.37	46.01	39.13	12.24	44.06	37.85	12.99	41.23	35.81	14.10	38.76	34.19	15.60
		33°C	49.45	49.45	10.81	47.32	47.32	11.45	47.63	47.63	12.35	45.88	45.88	13.11	41.83	41.83	14.24	40.04	40.04	15.76
	22°C	27°C	52.24	27.61	10.98	50.49	27.04	11.61	49.38	26.84	12.48	47.12	26.05	13.21	43.90	24.75	14.31	41.05	23.79	15.79
		30°C	52.63	34.34	10.98	50.61	33.58	11.61	49.48	33.46	12.49	47.25	32.63	13.22	44.01	31.13	14.32	41.16	30.10	15.80
		33°C	52.76	40.56	10.99	50.74	39.79	11.62	49.60	39.76	12.49	47.39	38.93	13.23	44.33	36.87	14.35	41.76	35.24	15.84
		36°C	52.99	45.05	11.03	51.17	43.88	11.68	50.55	43.79	12.57	48.52	42.50	13.32	45.70	40.55	14.44	43.22	38.87	15.96
5650	16°C	21°C	45.61	31.21	10.58	43.80	30.39	11.19	42.77	30.13	12.04	40.72	29.21	12.76	37.80	27.69	13.86	35.12	26.50	15.33
		24°C	45.90	38.49	10.60	44.24	37.37	11.21	43.33	36.89	12.07	41.41	35.59	12.81	38.59	33.52	13.91	36.09	31.82	15.39
		28°C	47.64	44.93	10.68	46.08	43.68	11.32	45.29	43.15	12.19	43.48	41.63	12.94	40.74	39.20	14.06	38.36	37.10	15.57
		30°C	49.38	49.38	10.84	47.75	47.75	11.48	46.05	46.05	12.37	44.27	44.27	13.13	41.05	41.05	14.26	38.76	38.76	15.76
	19°C	24°C	49.76	31.07	10.82	47.79	30.25	11.44	46.67	30.00	12.29	44.47	29.11	13.02	41.33	27.61	14.12	38.49	26.47	15.59
		27°C	50.00	38.53	10.83	48.04	37.70	11.45	46.92	37.59	12.31	44.72	36.67	13.04	41.71	34.75	14.14	39.07	33.00	15.63
		30°C	51.03	44.13	10.88	49.19	42.92	11.52	48.22	42.50	12.39	46.18	41.17	13.13	43.26	38.90	14.26	40.85	36.92	15.76
		33°C	52.12	52.12	11.00	50.46	50.46	11.66	48.70	48.70	12.56	46.82	46.82	13.32	43.95	43.95	14.46	41.59	41.59	15.97
	22°C	27°C	54.15	30.65	11.08	52.02	29.91	11.71	50.82	29.74	12.58	48.46	28.87	13.31	45.08	27.41	14.41	42.08	26.32	15.88
		30°C	54.34	38.29	11.09	52.22	37.49	11.72	51.02	37.40	12.59	48.67	36.51	13.33	45.29	34.88	14.43	42.33	33.78	15.90
		33°C	54.72	45.39	11.11	52.77	44.15	11.75	51.75	43.71	12.64	49.56	42.32	13.39	46.32	40.07	14.51	43.60	38.35	16.00
		36°C	55.74	48.99	11.19	53.78	48.01	11.84	52.42	47.14	12.75	50.49	45.64	13.52	46.96	42.65	14.67	44.05	40.21	16.20
6780	16°C	21°C	46.70	33.59	10.64	44.83	32.74	11.25	43.73	32.48	12.10	41.63	31.51	12.82	38.61	29.89	13.91	35.86	28.64	15.39
		24°C	47.52	40.82	10.69	45.72	39.59	11.30	44.74	39.10	12.16	42.73	37.73	12.90	39.81	35.57	13.99	37.35	33.59	15.49
		28°C	49.82	46.99	10.81	48.08	45.57	11.44	47.27	45.04	12.33	45.32	43.40	13.07	42.42	40.82	14.19	39.90	38.59	15.70
		30°C	51.16	51.16	10.98	49.43	49.43	11.63	47.62	47.62	12.52	45.72	45.72	13.28	43.03	43.03	14.40	40.15	40.15	15.91
	19°C	24°C	50.91	33.49	10.88	48.86	32.64	11.50	47.65	32.40	12.36	45.35	31.45	13.09	42.15	29.89	14.18	39.25	28.72	15.65
		27°C	51.25	41.96	10.90	49.26	40.97	11.53	48.24	40.47	12.40	46.07	39.04	13.14	42.96	36.82	14.24	40.24	35.02	15.72
		30°C	52.80	46.35	10.99	51.00	45.18	11.63	50.14	44.64	12.52	48.13	43.07	13.28	45.11	40.57	14.40	42.55	38.45	15.91
		33°C	54.03	54.03	11.16	52.27	52.27	11.82	50.90	50.90	12.72	48.94	48.94	13.49	45.90	45.90	14.62	42.91	42.91	16.14
	22°C	27°C	55.30	33.21	11.15	53.11	32.38	11.78	51.83	32.16	12.65	49.35	31.24	13.38	45.93	29.72	14.48	42.88	28.61	15.95
		30°C	55.62	41.78	11.17	53.40	40.93	11.80	52.12	40.86	12.67	49.67	39.93	13.41	46.29	38.09	14.51	43.44	36.28	15.99
		33°C	56.66	48.41	11.22	54.57	47.07	11.87	53.46	46.64	12.76	51.20	45.21	13.51	47.83	42.80	14.63	45.22	40.67	16.14
		36°C	57.59	50.76	11.35	55.14	48.85	12.02	54.34	48.38	12.94	52.28	46.78	13.71	48.58	43.69	14.85	46.00	41.58	16.38

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεκβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'estrapolazione. - Directe interpolatie is toegestaan. Extrapoleer niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmaz.
- Unit is able to operate at ambient from 0°C to 46°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 46°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 46°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 46°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 46° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 46°C zonder drukschakeling. - Блок может работать при температуре окружающей среды от 0 до 46°C без отключения, вызываемого давлением. - Ünite, 0°C ila 46°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)

EWB: Entering Wet Bulb Temp. - Eingangs-Feuchtemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)

EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)

TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)

SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)

PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

Capacity tables

7 - 1 Cooling Capacity Tables

7

UATYQ550CY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
5360	16°C	21°C	54.83	38.04	13.47	52.77	37.07	14.25	51.56	36.77	15.34	49.14	35.58	16.28	45.67	33.68	17.68	42.49	32.17	19.58
		24°C	55.05	44.34	13.48	52.96	43.34	14.26	51.76	43.15	15.35	49.36	42.01	16.29	46.04	39.67	17.71	43.09	37.61	19.62
		28°C	56.21	54.34	13.54	54.29	52.88	14.34	53.27	52.35	15.44	51.06	50.55	16.40	47.92	47.91	17.83	45.18	45.18	19.78
		30°C	57.67	57.67	13.68	55.88	55.88	14.50	53.95	53.95	15.63	51.92	51.92	16.61	48.73	48.73	18.05	46.05	46.05	20.00
	19°C	24°C	59.96	35.90	13.76	57.64	34.96	14.56	56.37	34.70	15.66	53.75	33.66	16.60	50.04	31.95	18.01	46.65	30.56	19.90
		27°C	60.12	44.19	13.77	57.83	43.21	14.57	56.53	43.04	15.67	53.94	41.93	16.61	50.21	39.96	18.02	46.85	38.55	19.92
		30°C	60.43	51.81	13.79	58.38	50.42	14.60	57.29	49.91	15.72	54.87	48.29	16.68	51.34	45.68	18.10	48.26	43.62	20.02
		33°C	61.57	61.57	13.88	58.92	58.92	14.70	59.31	59.31	15.85	57.14	57.14	16.83	52.10	52.10	18.29	49.86	49.86	20.24
	22°C	27°C	65.06	35.23	14.09	62.88	34.50	14.90	61.49	34.24	16.02	58.67	33.24	16.96	54.67	31.57	18.37	51.12	30.35	20.27
		30°C	65.54	43.81	14.10	63.03	42.84	14.91	61.61	42.68	16.03	58.84	41.62	16.97	54.81	39.72	18.39	51.25	38.39	20.28
		33°C	65.70	51.74	14.11	63.19	50.75	14.92	61.77	50.72	16.04	59.02	49.66	16.98	55.21	47.03	18.42	52.00	44.95	20.34
		36°C	65.99	57.46	14.16	63.72	55.98	14.99	62.96	55.86	16.13	60.42	54.22	17.10	56.91	51.73	18.54	53.83	49.59	20.49
6700	16°C	21°C	56.80	39.81	13.58	54.55	38.76	14.36	53.26	38.44	15.45	50.71	37.27	16.38	47.07	35.32	17.79	43.74	33.80	19.67
		24°C	57.15	49.10	13.60	55.10	47.67	14.40	53.96	47.06	15.50	51.57	45.40	16.44	48.05	42.76	17.85	44.95	40.60	19.76
		28°C	59.32	57.31	13.71	57.38	55.72	14.53	56.40	55.05	15.65	54.14	53.11	16.62	50.73	50.01	18.05	47.78	47.33	19.98
		30°C	61.50	61.50	13.92	59.47	59.47	14.74	57.35	57.35	15.88	55.13	55.13	16.85	51.13	51.13	18.30	48.26	48.26	20.23
	19°C	24°C	61.97	39.63	13.88	59.52	38.59	14.68	58.12	38.28	15.78	55.38	37.13	16.72	51.47	35.22	18.12	47.93	33.77	20.01
		27°C	62.27	49.15	13.90	59.82	48.09	14.70	58.43	47.95	15.80	55.69	46.78	16.74	51.95	44.33	18.15	48.65	42.10	20.06
		30°C	63.54	56.30	13.97	61.25	54.75	14.78	60.05	54.22	15.91	57.51	52.52	16.86	53.87	49.63	18.30	50.87	47.10	20.24
		33°C	64.91	64.91	14.13	62.83	62.83	14.97	60.64	60.64	16.12	58.31	58.31	17.10	54.73	54.73	18.56	51.79	51.79	20.51
	22°C	27°C	67.44	39.11	14.22	64.78	38.16	15.03	63.29	37.94	16.15	60.35	36.82	17.09	56.14	34.96	18.50	52.40	33.57	20.39
		30°C	67.67	48.84	14.24	65.03	47.82	15.05	63.54	47.70	16.17	60.61	46.57	17.11	56.41	44.49	18.52	52.71	43.09	20.41
		33°C	68.15	57.90	14.26	65.71	56.32	15.09	64.44	55.77	16.23	61.72	53.99	17.19	57.68	51.11	18.63	54.30	48.92	20.54
		36°C	69.42	62.50	14.37	66.98	61.24	15.21	65.28	60.14	16.37	62.88	58.22	17.36	58.48	54.41	18.83	54.86	51.30	20.79
8040	16°C	21°C	58.15	42.85	13.66	55.83	41.76	14.45	54.46	41.43	15.53	51.84	40.20	16.46	48.09	38.13	17.86	44.66	36.54	19.75
		24°C	59.18	52.07	13.72	56.93	50.51	14.51	55.71	49.88	15.61	53.21	48.13	16.56	49.58	45.38	17.96	46.51	42.85	19.89
		28°C	62.04	59.94	13.88	59.87	58.14	14.69	58.87	57.45	15.82	56.44	55.36	16.78	52.83	52.08	18.22	49.69	49.23	20.15
		30°C	63.71	63.71	14.10	61.56	61.56	14.93	59.30	59.30	16.07	56.94	56.94	17.04	53.59	53.59	18.49	50.00	50.00	20.42
	19°C	24°C	63.40	42.73	13.97	60.84	41.64	14.77	59.34	41.33	15.87	56.48	40.13	16.80	52.49	38.13	18.20	48.88	36.63	20.09
		27°C	63.82	53.53	14.00	61.34	52.26	14.80	60.07	51.62	15.91	57.37	49.80	16.86	53.49	46.97	18.28	50.11	44.68	20.18
		30°C	65.76	59.13	14.11	63.51	57.63	14.93	62.43	56.95	16.07	59.94	54.95	17.05	56.18	51.76	18.49	52.98	49.05	20.42
		33°C	67.29	67.29	14.33	65.09	65.09	15.17	63.39	63.39	16.33	60.95	60.95	17.31	57.16	57.16	18.77	53.44	53.44	20.72
	22°C	27°C	68.87	42.37	14.31	66.13	41.31	15.13	64.54	41.03	16.24	61.46	39.85	17.18	57.20	37.92	18.59	53.40	36.50	20.47
		30°C	69.26	53.30	14.34	66.50	52.21	15.15	64.91	52.13	16.27	61.85	50.94	17.21	57.65	48.59	18.62	54.09	46.28	20.53
		33°C	70.56	61.75	14.41	67.95	60.05	15.24	66.57	59.49	16.38	63.75	57.67	17.34	59.56	54.60	18.78	56.32	51.88	20.72
		36°C	71.72	64.76	14.57	68.66	62.31	15.43	67.67	61.72	16.61	65.10	59.68	17.59	60.50	55.73	19.07	57.28	53.04	21.03

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilatormotor. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεμβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'extrapolazione. - Directe interpolatie is toegestaan. Extrapoleren niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmamasına izin verilir. Ekstrapolasyon yapılmaz.
- Unit is able to operate at ambient from 0°C to 46°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 46°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 46°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 46°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 46° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 46°C zonder drukuitschakeling. - Блок может работать при температуре окружающей среды от 0 до 46°C без отключения, вызываемого давлением. - Ünite, 0°C ila 46°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

- AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)
- EWB: Entering Wet Bulb Temp. - Eingangs-Feuchtemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)
- EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)
- TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)
- SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θέρμανσης - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)
- PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

7 Capacity tables

7 - 1 Cooling Capacity Tables

UATYQ600CY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
5840	16°C	21°C	65.79	42.92	15.81	63.31	41.83	16.73	61.87	41.49	18.01	58.96	40.15	19.11	54.79	38.00	20.75	50.98	36.30	22.98
		24°C	66.05	50.03	15.82	63.54	48.91	16.74	62.11	48.69	18.02	59.22	47.41	19.12	55.24	44.77	20.78	51.70	42.44	23.03
		28°C	67.45	61.32	15.89	65.13	59.67	16.83	63.92	59.08	18.13	61.26	57.04	19.25	57.49	54.07	20.93	54.21	51.23	23.21
		30°C	69.20	69.20	16.06	67.05	67.05	17.03	64.74	64.74	18.35	62.29	62.29	19.50	58.46	58.46	21.19	55.26	55.26	23.48
	19°C	24°C	71.95	40.51	16.16	69.16	39.46	17.09	67.64	39.16	18.38	64.49	37.98	19.48	60.04	36.05	21.14	55.97	34.48	23.36
		27°C	72.14	49.87	16.17	69.39	48.76	17.10	67.83	48.57	18.39	64.72	47.31	19.50	60.24	45.09	21.15	56.21	43.50	23.38
		30°C	72.51	58.47	16.19	70.04	56.90	17.14	68.74	56.32	18.45	65.84	54.49	19.57	61.60	51.55	21.25	57.91	49.22	23.50
		33°C	73.88	73.88	16.29	70.70	70.70	17.26	71.16	71.16	18.60	68.56	68.56	19.75	62.51	62.51	21.46	59.83	59.83	23.75
	22°C	27°C	78.06	39.75	16.54	75.45	38.93	17.49	73.78	38.64	18.80	70.40	37.51	19.91	65.59	35.63	21.57	61.34	34.25	23.80
		30°C	78.64	49.44	16.55	75.63	48.34	17.50	73.93	48.16	18.81	70.60	46.97	19.92	65.77	44.82	21.58	61.50	43.32	23.81
		33°C	78.83	58.39	16.56	75.82	57.27	17.51	74.12	57.24	18.83	70.81	56.04	19.94	66.24	53.07	21.62	62.40	50.73	23.88
		36°C	79.18	64.84	16.62	76.46	63.17	17.60	75.54	63.04	18.94	72.49	61.18	20.07	68.28	58.37	21.77	64.58	55.96	24.05
7300	16°C	21°C	68.15	44.93	15.94	65.45	43.74	16.86	63.90	43.37	18.14	60.85	42.05	19.23	56.48	39.86	20.88	52.48	38.14	23.09
		24°C	68.58	55.41	15.97	66.11	53.79	16.90	64.75	53.10	18.19	61.88	51.23	19.30	57.66	48.25	20.96	53.93	45.81	23.20
		28°C	71.18	64.67	16.10	68.85	62.88	17.06	67.68	62.12	18.37	64.97	59.93	19.51	60.87	56.43	21.19	57.32	53.41	23.46
		30°C	73.79	73.79	16.34	71.35	71.35	17.30	68.81	68.81	18.64	66.14	66.14	19.78	61.34	61.34	21.48	57.91	57.91	23.75
	19°C	24°C	74.36	44.73	16.30	71.41	43.55	17.23	69.74	43.19	18.52	66.45	41.90	19.62	61.76	39.75	21.27	57.52	38.11	23.49
		27°C	74.72	55.47	16.32	71.78	54.27	17.25	70.11	54.11	18.55	66.82	52.79	19.65	62.33	50.02	21.31	58.37	47.51	23.55
		30°C	76.24	63.53	16.40	73.49	61.78	17.35	72.05	61.18	18.67	69.00	59.26	19.79	64.63	56.00	21.48	61.03	53.14	23.75
		33°C	77.88	77.88	16.58	75.39	75.39	17.57	72.76	72.76	18.92	69.96	69.96	20.08	65.67	65.67	21.79	62.14	62.14	24.07
	22°C	27°C	80.91	44.13	16.69	77.73	43.06	17.64	75.94	42.81	18.96	72.41	41.55	20.06	67.36	39.45	21.71	62.88	37.88	23.93
		30°C	81.20	55.11	16.71	78.02	53.96	17.66	76.24	53.83	18.98	72.72	52.55	20.08	67.68	50.21	21.74	63.24	48.62	23.96
		33°C	81.77	65.34	16.74	78.85	63.55	17.71	77.32	62.93	19.05	74.05	60.93	20.17	69.21	57.68	21.86	65.15	55.20	24.11
		36°C	83.29	70.53	16.87	80.36	69.10	17.85	78.33	67.86	19.21	75.44	65.69	20.38	70.16	61.40	22.10	65.82	57.89	24.41
8760	16°C	21°C	69.77	48.35	16.04	66.98	47.13	16.96	65.35	46.76	18.23	62.20	45.37	19.32	57.70	43.03	20.97	53.58	41.23	23.18
		24°C	71.01	58.76	16.10	68.31	57.00	17.03	66.85	56.28	18.33	63.84	54.31	19.43	59.48	51.21	21.09	55.81	48.35	23.34
		28°C	74.44	67.64	16.29	71.84	65.61	17.25	70.63	64.83	18.58	67.72	62.47	19.70	63.39	58.77	21.39	59.62	55.55	23.65
		30°C	76.44	76.44	16.55	73.86	73.86	17.53	71.16	71.16	18.87	68.32	68.32	20.01	64.30	64.30	21.70	59.99	59.99	23.97
	19°C	24°C	76.07	48.22	16.40	73.00	46.99	17.34	71.20	46.64	18.63	67.77	45.28	19.72	62.99	43.03	21.37	58.65	41.34	23.58
		27°C	76.57	60.41	16.43	73.60	58.97	17.37	72.07	58.25	18.68	68.84	56.20	19.79	64.19	53.00	21.46	60.13	50.42	23.69
		30°C	78.90	66.72	16.56	76.20	65.04	17.53	74.91	64.26	18.87	71.92	62.01	20.01	67.41	58.40	21.70	63.57	55.36	23.97
		33°C	80.73	80.73	16.82	78.10	78.10	17.81	76.06	76.06	19.17	73.13	73.13	20.32	68.58	68.58	22.04	64.12	64.12	24.32
	22°C	27°C	82.63	47.81	16.80	79.35	46.62	17.75	77.44	46.30	19.07	73.74	44.97	20.17	68.63	42.79	21.82	64.07	41.19	24.03
		30°C	83.11	60.14	16.83	79.79	58.92	17.78	77.88	58.82	19.10	74.21	57.49	20.20	69.17	54.83	21.86	64.90	52.22	24.10
		33°C	84.67	69.68	16.91	81.53	67.76	17.89	79.87	67.13	19.23	76.50	65.07	20.35	71.47	61.61	22.04	67.57	58.55	24.32
		36°C	86.05	73.08	17.10	82.38	70.32	18.11	81.19	69.65	19.49	78.11	67.34	20.65	72.59	62.89	22.38	68.73	59.85	24.68

NOTES - ANMERKUNGEN - ΣΗΜΕΙΩΣΕΙΣ - NOTAS - REMARQUES - NOTE - OPMERKINGEN - ПРИМЕЧАНИЯ - NOTLAR

- Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat. - Die Nennwerte sind Bruttoleistungen, die keine Abzüge für die Motorwärme der Innenventilatoren enthalten. - Οι τιμές που αναφέρονται αντιπροσωπεύουν μικτή απόδοση, χωρίς κάποια μικρή απόκλιση που αντιστοιχεί στη θέρμανση του κινητήρα του ανεμιστήρα της εσωτερικής μονάδας. - Los valores indicados son capacidades brutas a las que no se ha restado el valor correspondiente al calor del motor del ventilador interior. - Les valeurs nominales indiquées correspondent à des puissances brutes qui n'incluent aucune déduction pour la chaleur du moteur de ventilateur de l'unité intérieure. - I valori indicati si riferiscono alle capacità lorde e non comprendono la riduzione per l'apporto di calore generato dal motore del ventilatore dell'unità interna. - De weergegeven cijfers zijn brutocapaciteiten excl. reductiefactor voor warmte afgegeven door de binnenventilator. - Указанные номинальные значения являются общими, т.е. не учитывают нагревание от двигателя внутреннего вентилятора. - Gösterilen değerler, iç ünite fan motoru sıcaklığının dikkate alınmadığı brüt kapasite değerleridir.
- shows nominal capacities. - stellt Nennleistungen dar. - υποδεικνύει ονομαστικές τιμές απόδοσης. - indica capacidades nominales. - indique les puissances nominales. - mostra le capacità nominali. - geeft nominale capaciteiten weer. - показывает номинальные значения мощности. - nominal kapasite değerlerini gösterir.
- Direct interpolation is permissible. Do not extrapolate. - Direkte Interpolation ist zulässig. Extrapolieren ist nicht zulässig. - Επιτρέπεται η απευθείας παρεμβολή. Όχι όμως η παρεκβολή. - Se permite la interpolación directa. Sin embargo, no extrapole. - Interpolation directe autorisée. Ne pas extrapoler. - È consentita l'interpolazione diretta. Non è tuttavia permessa l'estrapolazione. - Directe interpolatie is toegestaan. Extrapoler niet. - Допускается прямая интерполяция. Экстраполяция не допускается. - Doğrudan interpolasyon yapılmazına izin verilir. Ekstrapolasyon yapılmaz.
- Unit is able to operate at ambient from 0°C to 52°C without pressure trip. - Gerät kann bei Umgebungstemperaturen von 0°C bis 52°C ohne Druckabfall betrieben werden. - Η μονάδα έχει τη δυνατότητα να λειτουργεί σε θερμοκρασία περιβάλλοντος από 0°C έως 52°C χωρίς πτώση πίεσης. - La unidad puede funcionar con temperaturas ambiente de entre 0 y 52°C sin cortes por presión. - L'unité est en mesure de fonctionner par température extérieure comprise entre 0 °C et 46 °C sans déclenchement pression. - L'unità è in grado di funzionare con temperature esterne comprese tra 0° e 52° senza cali di pressione. - De unit kan werken bij omgevingstemperaturen van 0°C tot 52°C zonder drukschakeling. - Блок может работать при температуре окружающей среды от 0 до 52°C без отключения, вызываемого давлением. - Ünite, 0°C ila 52°C ortam sıcaklığında basınç problemi olmadan çalışabilir.

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

AFR: Air flow rate - Luftdurchsatz - Ταχύτητα ροής αέρα - Caudal de aire - Débit d'air - Portata d'aria - Luchtdebiet - Скорость воздушного потока - Hava akış hızı (CFM)

EWB: Entering Wet Bulb Temp. - Eingangs-Feuchtemp. - Είσοδος σε θερμ. υγρού βολβού - Temperatura de bulbo húmedo de entrada - Température d'entrée du réservoir humide - Temp. bulbo umido in entrata - Temperatuur ingaand natte bol - Температура на входе влажного термометра. - Giriş ıslak hazne sıcaklığı (°C)

EDB: Entering Dry Bulb Temp. - Eingangs-Trockentemp. - Είσοδος σε θερμ. λυχνίας αφύγρανσης - Temperatura de bulbo seco de entrada - Température d'entrée du réservoir sec - Temp. bulbo secco in entrata - Temperatuur ingaand droge bol - Температура на входе сухого термометра. - Giriş kuru hazne sıcaklığı (°C)

TC: Total Cooling Capacity - Gesamte Kühlleistung - Συνολική απόδοση ψύξης - Capacidad de refrigeración total - Puissance totale de refroidissement - Capacità di raffreddamento totale - Totaal koelvermogen - Общая охлаждающая способность - Toplam soğutma kapasitesi (kW)

SHC: Sensible Heat Capacity - Sensible Wärmekapazität - Απόδοση αισθητής θερμότητας - Capacidad de calor sensible - Puissance calorifique sensible - Capacità termica sensibile - Voelbaar verwarmingsvermogen - Производительность по сухому теплу - Hissedilebilir ısı kapasitesi (kW)

PI: Power Input - Leistungsaufnahme - Είσοδος ισχύος - Consumo - Puissance absorbée - Potenza assorbita - Vermogeninput - Потребляемая мощность - Güç girişi

7 Capacity tables

7 - 1 Cooling Capacity Tables

7

UATYQ700CY1

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI
6640	16°C	21°C	71.48	48.41	17.39	68.79	47.18	18.40	67.22	46.79	19.80	64.06	45.28	21.01	59.53	42.86	22.82	55.39	40.94	25.27
		24°C	71.76	56.43	17.40	69.04	55.16	18.41	67.48	54.91	19.82	64.35	53.47	21.03	60.02	50.48	22.86	56.18	47.87	25.33
		27°C	73.28	69.15	17.48	70.77	67.29	18.51	69.45	66.62	19.93	66.56	64.33	21.17	62.47	60.97	23.02	58.90	57.78	25.53
		30°C	75.19	75.19	17.67	72.85	72.85	18.72	70.34	70.34	20.18	67.68	67.68	21.44	63.52	63.52	23.31	60.04	60.04	25.82
	19°C	24°C	78.17	45.69	17.77	75.14	44.49	18.80	73.49	44.16	20.22	70.07	42.83	21.43	65.23	40.66	23.25	60.81	38.89	25.69
		27°C	78.38	56.24	17.78	75.39	54.99	18.81	73.70	54.77	20.23	70.32	53.36	21.44	65.45	50.85	23.26	61.07	49.05	25.71
		30°C	78.78	65.94	17.80	76.10	64.16	18.85	74.69	63.52	20.29	71.53	61.45	21.53	66.93	58.13	23.37	62.92	55.50	25.85
		33°C	80.27	80.27	17.92	76.81	76.81	18.98	77.32	77.32	20.46	74.49	74.49	21.72	67.92	67.92	23.61	65.00	65.00	26.12
	22°C	27°C	84.81	44.83	18.19	81.97	43.90	19.24	80.16	43.57	20.68	76.49	42.30	21.89	71.27	40.18	23.72	66.65	38.63	26.17
		30°C	85.44	55.75	18.20	82.17	54.52	19.25	80.32	54.31	20.69	76.71	52.97	21.91	71.46	50.54	23.74	66.82	48.86	26.18
		33°C	85.64	65.85	18.21	82.38	64.59	19.26	80.53	64.55	20.71	76.94	63.19	21.93	71.97	59.85	23.78	67.79	57.21	26.26
		36°C	86.03	73.13	18.28	83.07	71.24	19.35	82.07	71.09	20.82	78.76	69.00	22.07	74.19	65.83	23.94	70.17	63.11	26.45
8300	16°C	21°C	74.05	50.67	17.53	71.11	49.33	18.54	69.43	48.91	19.95	66.11	47.42	21.15	61.36	44.95	22.96	57.02	43.01	25.40
		24°C	74.51	62.49	17.56	71.83	60.66	18.58	70.35	59.89	20.01	67.23	57.77	21.22	62.64	54.42	23.05	58.60	51.66	25.51
		27°C	77.33	72.94	17.70	74.81	70.91	18.76	73.53	70.05	20.21	70.59	67.58	21.45	66.13	63.64	23.30	62.28	60.23	25.80
		30°C	80.17	80.17	17.96	77.52	77.52	19.03	74.76	74.76	20.50	71.87	71.87	21.76	66.65	66.65	23.62	62.92	62.92	26.12
	19°C	24°C	80.79	50.44	17.92	77.59	49.11	18.95	75.77	48.71	20.37	72.20	47.25	21.58	67.10	44.82	23.39	62.49	42.97	25.84
		27°C	81.18	62.55	17.95	77.98	61.20	18.98	76.17	61.02	20.40	72.60	59.53	21.61	67.72	56.41	23.43	63.42	53.58	25.90
		30°C	82.84	71.64	18.03	79.85	69.67	19.08	78.28	69.00	20.54	74.97	66.83	21.77	70.22	63.15	23.63	66.31	59.93	26.12
		33°C	84.61	84.61	18.24	81.91	81.91	19.32	79.05	79.05	20.81	76.02	76.02	22.08	71.35	71.35	23.96	67.52	67.52	26.47
	22°C	27°C	87.91	49.76	18.36	84.45	48.56	19.40	82.51	48.28	20.85	78.67	46.86	22.06	73.18	44.49	23.88	68.31	42.72	26.32
		30°C	88.22	62.15	18.38	84.77	60.86	19.42	82.83	60.71	20.87	79.01	59.27	22.09	73.53	56.62	23.91	68.72	54.83	26.35
		33°C	88.84	73.68	18.41	85.67	71.67	19.48	84.01	70.97	20.95	80.45	68.71	22.19	75.20	65.04	24.05	70.78	62.25	26.51
		36°C	90.50	79.53	18.55	87.31	77.93	19.63	85.10	76.53	21.13	81.97	74.08	22.41	76.23	69.25	24.31	71.51	65.28	26.84
9960	16°C	21°C	75.81	54.53	17.64	72.78	53.15	18.65	71.00	52.73	20.05	67.58	51.16	21.25	62.69	48.52	23.06	58.21	46.50	25.50
		24°C	77.15	66.27	17.71	74.22	64.28	18.73	72.63	63.47	20.16	69.37	61.25	21.37	64.63	57.75	23.19	60.63	54.53	25.67
		27°C	80.88	76.28	17.91	78.05	73.99	18.97	76.74	73.11	20.43	73.58	70.45	21.67	68.87	66.27	23.52	64.78	62.64	26.01
		30°C	83.05	83.05	18.20	80.25	80.25	19.27	77.31	77.31	20.75	74.23	74.23	22.00	69.86	69.86	23.87	65.18	65.18	26.36
	19°C	24°C	82.65	54.37	18.04	79.31	52.99	19.07	77.36	52.59	20.49	73.63	51.06	21.69	68.43	48.53	23.50	63.73	46.62	25.93
		27°C	83.20	68.12	18.07	79.96	66.50	19.10	78.31	65.69	20.54	74.79	63.38	21.77	69.74	59.77	23.60	65.33	56.86	26.05
		30°C	85.72	75.24	18.21	82.79	73.34	19.27	81.39	72.47	20.75	78.14	69.93	22.00	73.24	65.86	23.87	69.07	62.43	26.36
		33°C	87.72	87.72	18.50	84.85	84.85	19.59	82.64	82.64	21.08	79.46	79.46	22.35	74.51	74.51	24.23	69.66	69.66	26.74
	22°C	27°C	89.78	53.91	18.48	86.22	52.57	19.53	84.13	52.21	20.97	80.12	50.72	22.18	74.57	48.25	23.99	69.62	46.45	26.43
		30°C	90.30	67.83	18.51	86.69	66.44	19.56	84.62	66.34	21.00	80.63	64.83	22.22	75.15	61.84	24.04	70.51	58.89	26.50
		33°C	91.99	78.58	18.60	88.59	76.42	19.67	86.78	75.71	21.14	83.11	73.39	22.38	77.65	69.48	24.24	73.42	66.03	26.74
		36°C	93.50	82.41	18.81	89.51	79.30	19.92	88.22	78.55	21.44	84.87	75.94	22.71	78.86	70.92	24.61	74.68	67.49	27.15

REMARK - BEMERKUNGEN - ΠΑΡΑΤΗΡΗΣΕΙΣ - OBSERVACIONES - REMARQUES - NOTE - OPMERKINGEN - ЗАМЕЧАНИЯ - DÜŞÜNCELER

AFR: Air flow rate - *Luftdurchsatz* - Ταχύτητα ροής αέρα - *Caudal de aire* - Débit d'air - *Portata d'aria* - Luchtdebiet - *Скорость воздушного потока* - Hava akışı hızı (CFM)

EWB: Entering Wet Bulb Temp. - *Eingangs-Feuchtemp.* - Είσοδος σε θερμ. υγρού βολβού - *Temperatura de bulbo húmedo de entrada* - Température d'entrée du réservoir humide - *Temp. bulbo umido in entrata* - Temperatuur ingaand natte bol - *Температура на входе влажного термометра.* - Giriş ıslak hazne sıcaklığı (°C)

EDB: Entering Dry Bulb Temp. - *Eingangs-Trockentemp.* - Είσοδος σε θερμ. λυχνίας αφύγρανσης - *Temperatura de bulbo seco de entrada* - Température d'entrée du réservoir sec - *Temp. bulbo secco in entrata* - Temperatuur ingaand droge bol - *Температура на входе сухого термометра.* - Giriş kuru hazne sıcaklığı (°C)

TC: Total Cooling Capacity - *Gesamte Kühlleistung* - Συνολική απόδοση ψύξης - *Capacidad de refrigeración total* - Puissance totale de refroidissement - *Capacità di raffreddamento totale* - Totaal koelvermogen - *Общая охлаждающая способность* - Toplam soğutma kapasitesi (kW)

SC: Sensible capacity - *Sensible Kapazität* - Αισθητή απόδοση - *Capacidad sensible* - Capacité sensible - *Capacità sensibile* - Voelbaar vermogen - *Производительность по сухой теплу* - Hissedilebilir kapasite (kW)

PI: Power Input - *Leistungsaufnahme* - Είσοδος ισχύος - *Consumo* - Puissance absorbée - *Potenza assorbita* - Vermogeninput - *Потребляемая мощность* - Güç girişi

7 Capacity tables

7 - 1 Cooling Capacity Tables

UATYQ900CY1

AFR: Air flow rate (CFM) ; EWB: Entering Wet Bulb Temp. (°C) ; EDB: Entering Dry Bulb Temp. (°C) ;
TC: Total Cooling Capacity (kW) ; SC: Sensible Cooling Capacity (kW) ; PI: Power Input

AFR (CFM)	EWB	EDB	Outdoor temperature																	
			19°C			25°C			30°C			35°C			40°C			46°C		
			TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI	TC	SC	PI
7680	16°C	21°C	82,90	54,09	27,60	79,78	52,72	29,20	77,96	52,29	31,43	74,30	50,60	33,35	69,04	47,89	36,23	64,24	45,74	40,11
		24°C	83,22	63,05	27,62	80,07	61,63	29,23	78,27	61,35	31,46	74,63	59,74	33,38	69,61	56,41	36,28	65,15	53,48	40,20
		27°C	84,99	77,27	27,74	82,08	75,19	29,37	80,55	74,44	31,64	77,20	71,88	33,60	72,45	68,13	36,54	68,31	64,56	40,52
		30°C	87,20	87,20	28,04	84,49	84,49	29,72	81,57	81,57	32,04	78,49	78,49	34,03	73,67	73,67	36,99	69,63	69,63	40,98
	19°C	24°C	90,66	51,05	28,20	87,15	49,72	29,83	85,23	49,34	32,09	81,27	47,86	34,01	75,65	45,43	36,90	70,53	43,45	40,78
		27°C	90,90	62,84	28,22	87,44	61,44	29,85	85,48	61,20	32,11	81,55	59,62	34,04	75,91	56,82	36,92	70,83	54,81	40,81
		30°C	91,37	73,68	28,26	88,26	71,70	29,91	86,62	70,97	32,21	82,96	68,66	34,17	77,62	64,96	37,09	72,97	62,02	41,02
		33°C	93,10	93,10	28,44	89,09	89,09	30,12	89,67	89,67	32,47	86,39	86,39	34,48	78,77	78,77	37,47	75,39	75,39	41,46
	22°C	27°C	98,36	50,09	28,87	95,07	49,06	30,53	92,97	48,69	32,82	88,71	47,26	34,75	82,66	44,89	37,65	77,29	43,16	41,54
		30°C	99,09	62,30	28,89	95,30	60,92	30,55	93,16	60,69	32,84	88,97	59,19	34,77	82,87	56,47	37,67	77,49	54,59	41,55
		33°C	99,33	73,58	28,91	95,54	72,17	30,57	93,39	72,13	32,87	89,23	70,61	34,80	83,47	66,88	37,74	78,62	63,92	41,68
		36°C	99,78	81,71	29,01	96,34	79,60	30,72	95,18	79,43	33,05	91,35	77,10	35,04	86,04	73,55	37,99	81,38	70,51	41,98
9600	16°C	21°C	85,88	56,61	27,83	82,48	55,12	29,43	80,52	54,66	31,66	76,67	52,99	33,57	71,17	50,22	36,44	66,13	48,06	40,31
		24°C	86,41	69,82	27,88	83,30	67,78	29,50	81,59	66,92	31,75	77,98	64,55	33,69	72,65	60,80	36,58	67,96	57,72	40,49
		27°C	89,69	81,50	28,10	86,76	79,24	29,77	85,28	78,28	32,07	81,86	75,52	34,05	76,70	71,11	36,99	72,23	67,30	40,95
		30°C	92,98	92,98	28,51	89,91	89,91	30,20	86,71	86,71	32,54	83,35	83,35	34,53	77,30	77,30	37,50	72,97	72,97	41,46
	19°C	24°C	93,70	56,36	28,45	89,98	54,87	30,08	87,87	54,43	32,34	83,73	52,80	34,25	77,82	50,09	37,13	72,47	48,02	41,01
		27°C	94,15	69,89	28,49	90,44	68,39	30,12	88,34	68,18	32,38	84,20	66,52	34,30	78,54	63,03	37,19	73,56	59,86	41,11
		30°C	96,07	80,05	28,62	92,61	77,85	30,29	90,79	77,10	32,59	86,95	74,68	34,55	81,44	70,57	37,50	76,91	66,97	41,46
		33°C	98,13	98,13	28,95	95,00	95,00	30,67	91,68	91,68	33,03	88,16	88,16	35,04	82,76	82,76	38,04	78,31	78,31	42,02
	22°C	27°C	101,96	55,61	29,14	97,95	54,26	30,80	95,69	53,94	33,09	91,24	52,36	35,01	84,88	49,71	37,90	79,23	47,74	41,77
		30°C	102,32	69,45	29,17	98,32	68,00	30,83	96,07	67,83	33,12	91,64	66,22	35,06	85,28	63,27	37,95	79,69	61,27	41,82
		33°C	103,04	82,33	29,22	99,36	80,08	30,92	97,44	79,30	33,25	93,31	76,77	35,22	87,21	72,68	38,16	82,09	69,56	42,08
		36°C	104,96	88,87	29,44	101,26	87,08	31,16	98,70	85,51	33,53	95,07	82,78	35,57	88,41	77,37	38,58	82,94	72,94	42,60
11520	16°C	21°C	87,92	60,93	28,00	84,41	59,38	29,60	82,35	58,92	31,83	78,38	57,17	33,73	72,71	54,22	36,60	67,52	51,95	40,47
		24°C	89,47	74,05	28,11	86,08	71,82	29,74	84,24	70,92	31,99	80,45	68,44	33,92	74,96	64,53	36,81	70,32	60,93	40,75
		27°C	93,80	85,23	28,43	90,52	82,67	30,10	89,00	81,69	32,42	85,33	78,72	34,39	79,87	74,05	37,33	75,12	70,00	41,28
		30°C	96,32	96,32	28,89	93,07	93,07	30,59	89,66	89,66	32,93	86,09	86,09	34,92	81,03	81,03	37,88	75,60	75,60	41,84
	19°C	24°C	95,85	60,76	28,63	91,99	59,21	30,26	89,72	58,77	32,52	85,39	57,06	34,43	79,37	54,22	37,30	73,91	52,09	41,16
		27°C	96,49	76,12	28,68	92,74	74,31	30,32	90,82	73,40	32,61	86,75	70,81	34,55	80,88	66,78	37,45	75,77	63,53	41,35
		30°C	99,42	84,07	28,90	96,02	81,95	30,59	94,40	80,98	32,93	90,63	78,14	34,93	84,94	73,59	37,88	80,11	69,75	41,84
		33°C	101,73	101,73	29,36	98,41	98,41	31,09	95,84	95,84	33,46	92,15	92,15	35,47	86,42	86,42	38,46	80,79	80,79	42,45
	22°C	27°C	104,12	60,24	29,33	99,99	58,74	30,99	97,58	58,34	33,28	92,92	56,67	35,20	86,49	53,92	38,09	80,74	51,90	41,94
		30°C	104,72	75,79	29,38	100,55	74,24	31,04	98,14	74,12	33,34	93,51	72,44	35,26	87,16	69,10	38,16	81,78	65,81	42,06
		33°C	106,69	87,81	29,52	102,74	85,39	31,23	100,65	84,60	33,56	96,39	82,00	35,52	90,06	77,64	38,47	85,15	73,78	42,45
		36°C	108,43	92,08	29,85	103,81	88,61	31,62	102,31	87,77	34,03	98,43	84,86	36,05	91,47	79,25	39,07	86,61	75,42	43,09

NOTES

1. Ratings shown are gross capacities which do not include a deduction for indoor fan motor heat.
2. shows nominal capacities.
3. Direct interpolation is permissible. Do not extrapolate.
4. Unit is able to operate at ambient from 0°C to 46°C without pressure trip.

7 Capacity tables

7 - 2 Heating Capacity Tables

7

UATYQ250CY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	17.71	5.41	24.99	6.49	28.96	7.08	30.95	7.38	32.93	7.67
17	17.23	5.64	24.96	6.77	28.12	7.39	30.04	7.70	31.96	8.01
19	16.75	5.87	24.93	7.05	27.27	7.70	29.12	8.02	30.98	8.34
51	16.27	6.09	24.31	7.33	26.42	8.00	28.21	8.34	30.00	8.68
23	15.79	6.32	23.10	7.61	25.57	8.31	27.30	8.66	29.03	9.01
25	15.31	6.55	21.89	7.89	24.73	8.62	26.39	8.98	28.05	9.35
27	14.83	6.78	20.69	8.17	23.88	8.92	25.48	9.30	27.08	9.68

UATYQ350CY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	24.73	7.83	34.90	9.40	40.44	10.25	43.21	10.68	45.99	11.11
17	24.23	8.18	34.86	9.88	40.18	10.80	42.99	11.27	45.80	11.73
19	23.74	8.53	34.81	10.36	39.91	11.36	42.76	11.86	45.61	12.35
51	23.24	8.88	34.51	10.84	39.64	11.91	42.53	12.44	45.43	12.98
23	22.74	9.23	33.94	11.32	39.37	12.46	42.31	13.03	45.24	13.60
25	22.25	9.58	33.37	11.80	39.11	13.01	42.08	13.62	45.06	14.22
27	21.75	9.93	32.81	12.28	38.84	13.57	41.85	14.21	44.87	14.85

NOTES - Hinweise - Σημειώσεις - Notas - Remarques - Note - Aantekeningen - Примечания - Notlar

TC = Total Cooling Capacity (kW) - Gesamte Kühlleistung (kW) - Συνολική απόδοση ψύξης (kW) - Capacidad de refrigeración total (kW) - Puissance totale de refroidissement (kW) - Capacità di raffreddamento totale (kW) - Totaal koelvermogen (kW) - Общая охлаждающая способность (kW) - Toplam soğutma kapasitesi (kW)

PI = Power Input (kW) - Leistungsaufnahme (kW) - Είσοδος ισχύος (kW) - Consumo (kW) - Puissance absorbée (kW) - Potenza assorbita (kW) - Vermogeninput (kW) - Потребляемая мощность (kW) - Güç girişi (kW)

UATYQ450CY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	29.71	9.55	41.92	11.46	48.58	12.50	51.92	13.02	55.25	13.54
17	29.15	9.94	41.87	11.92	48.43	13.00	51.83	13.55	55.24	14.09
19	28.58	10.34	41.82	12.39	48.28	13.51	51.75	14.07	55.23	14.63
51	28.01	10.73	41.56	12.86	48.12	14.02	51.67	14.60	55.22	15.18
23	27.45	11.13	41.08	13.33	47.97	14.53	51.59	15.13	55.21	15.73
25	26.88	11.52	40.61	13.80	47.82	15.04	51.51	15.66	55.21	16.28
27	26.32	11.92	40.13	14.26	47.67	15.54	51.43	16.18	55.20	16.82

UATYQ550CY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	38.34	11.76	54.09	14.11	62.69	15.39	66.99	16.03	71.28	16.67
17	37.53	12.22	54.03	14.58	62.09	15.88	66.42	16.52	70.76	17.17
19	36.72	12.68	53.96	15.06	61.49	16.36	65.86	17.01	70.23	17.66
51	35.92	13.14	53.38	15.54	60.89	16.85	65.29	17.51	69.70	18.16
23	35.11	13.60	52.27	16.02	60.29	17.34	64.73	18.00	69.17	18.66
25	34.30	14.06	51.16	16.49	59.69	17.82	64.17	18.49	68.64	19.15
27	33.50	14.52	50.05	16.97	59.09	18.31	63.60	18.98	68.12	19.65

NOTES - Hinweise - Σημειώσεις - Notas - Remarques - Note - Aantekeningen - Примечания - Notlar

TC = Total Cooling Capacity (kW) - Gesamte Kühlleistung (kW) - Συνολική απόδοση ψύξης (kW) - Capacidad de refrigeración total (kW) - Puissance totale de refroidissement (kW) - Capacità di raffreddamento totale (kW) - Totaal koelvermogen (kW) - Общая охлаждающая способность (kW) - Toplam soğutma kapasitesi (kW)

PI = Power Input (kW) - Leistungsaufnahme (kW) - Είσοδος ισχύος (kW) - Consumo (kW) - Puissance absorbée (kW) - Potenza assorbita (kW) - Vermogeninput (kW) - Потребляемая мощность (kW) - Güç girişi (kW)

7 Capacity tables

7 - 2 Heating Capacity Tables

7

UATYQ600CY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	43.85	14.19	61.88	17.03	71.71	18.58	76.63	19.36	81.55	20.13
17	42.61	14.83	61.81	17.91	69.37	19.58	74.10	20.42	78.82	21.26
19	41.38	15.47	61.73	18.78	67.04	20.59	71.56	21.49	76.09	22.39
51	40.14	16.10	60.05	19.65	64.70	21.59	69.03	22.55	73.36	23.52
23	38.90	16.73	56.76	20.52	62.36	22.59	66.50	23.62	70.64	24.65
25	37.67	17.37	53.47	21.39	60.02	23.59	63.96	24.69	67.91	25.79
27	36.43	18.00	50.18	22.27	57.68	24.59	61.43	25.75	65.18	26.92

UATYQ700CY1

Indoor DB, °C	Outdoor WB, °C									
	-5		6		12		15		18	
	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)	TC (kW)	PI (kW)
15	49.48	13.42	69.82	16.11	80.91	17.57	86.46	18.30	92.00	19.03
17	48.43	14.02	69.73	16.93	80.08	18.52	85.67	19.31	91.26	20.10
19	47.38	14.63	69.65	17.76	79.26	19.46	84.88	20.32	90.51	21.17
51	46.32	15.22	68.86	18.58	78.43	20.41	84.09	21.33	89.76	22.24
23	45.27	15.82	67.37	19.40	77.60	21.36	83.31	22.33	89.01	23.31
25	44.22	16.42	65.87	20.23	76.77	22.31	82.52	23.34	88.26	24.38
27	43.17	17.02	64.38	21.05	75.95	23.25	81.73	24.35	87.52	25.45

NOTES - Hinweise - Σημειώσεις - Notas - Remarques - Note - Aantekeningen - Примечания - Notlar

TC = Total Cooling Capacity (kW) - Gesamte Kühlleistung (kW) - Συνολική απόδοση ψύξης (kW) - Capacidad de refrigeración total (kW) - Puissance totale de refroidissement (kW) - Capacità di raffreddamento totale (kW) - Totaal koelvermogen (kW) - Общая охлаждающая способность (kW) - Toplam soğutma kapasitesi (kW)

PI = Power Input (kW) - Leistungsaufnahme (kW) - Είσοδος ισχύος (kW) - Consumo (kW) - Puissance absorbée (kW) - Potenza assorbita (kW) - Vermogeninput (kW) - Потребляемая мощность (kW) - Güç girişi (kW)

UATYQ900CY1

Indoor DB°C	Outdoor WB°C													
	-9		-6		-5		6		12		15		18	
	TC (kW)	SC (kW)	TC (kW)	SC (kW)	TC (kW)	SC (kW)	TC (kW)	SC (kW)	TC (kW)	SC (kW)	TC (kW)	SC (kW)	TC (kW)	SC (kW)
15	55,013	55,013	62,266	62,266	64,683	64,683	91,275	91,275	105,779	105,779	113,031	113,031	120,284	120,284
17	53,571	53,571	59,634	59,634	63,278	63,278	91,166	91,166	104,531	104,531	111,811	111,811	119,091	119,091
19	52,129	52,129	57,002	57,002	61,873	61,873	91,057	91,057	103,284	103,284	110,591	110,591	117,899	117,899
21	50,687	50,687	55,413	55,413	60,468	60,468	89,924	89,924	102,036	102,036	109,371	109,371	116,707	116,707
23	49,245	49,245	54,869	54,869	59,062	59,062	87,768	87,768	100,788	100,788	108,151	108,151	115,515	115,515
25	47,802	47,802	54,324	54,324	57,657	57,657	85,611	85,611	99,540	99,540	106,931	106,931	114,322	114,322
27	46,360	46,360	53,779	53,779	56,252	56,252	83,455	83,455	98,292	98,292	105,711	105,711	113,130	113,130
	FROST REGION													

7 Capacity tables

7 - 3 Capacity Correction Factor

Performance Adjustment

- Performance Adjustment

Performance of the unit will derate when it operates with fresh air mode and this condition depends on user's selection. Before installation, it is recommended to check the correction factor table (table 1) below in order to do a correct design selection. Noted that it has different factor used for different selection of fresh air opening, in both cool mode and heat mode.

Table 1: Correction factor for unit's performance.

Rooftop Model	Economiser Kit Model	Operation Mode	Fresh Air Opening (%)					
			0	5	10	15	20	25
UATYQ Series	ECONO Series	Cooling	1.00	0.97	0.93	0.90	0.86	0.80
		Heating	1.00	0.97	0.93	0.90	0.87	0.83

- Pressure Drop Table

Airflow resistance refers to pressure drop caused by the economiser kit. Before installation, it is recommended to check the pressure drop in table 2 below in order to do a correct design selection.

Table 2: Pressure drop in economiser kit

Rooftop Model	Economiser Kit Model	Standard Airflow Rate		Maximum Pressure Drop in Economiser Kit							
				Side Return (Horizontal) Application						Down Return (Vertical) Application	
				Fresh Air Mode						Economiser Mode	Fresh Air Mode or Economiser Mode
		Cfm	m3/s	0% Outdoor Air Damper Opening (Pa)	5% Outdoor Air Damper Opening (Pa)	10% Outdoor Air Damper Opening (Pa)	15% Outdoor Air Damper Opening (Pa)	20% Outdoor Air Damper Opening (Pa)	25% Outdoor Air Damper Opening (Pa)	Maximum Pressure Drop (Pa)	Pressure Drop (Pa)
UATYQ250	ECONO250	3300	1.56	0	3	5	10	13	15	20	0
UATYQ350	ECONO350	4300	2.03	0	5	10	13	20	30	40	0
UATYQ450	ECONO450	5650	2.67	0	7	21	38	53	58	68	0
UATYQ550	ECONO550	6700	3.16	0	15	30	50	60	65	70	0
UATYQ600	ECONO600	7300	3.45	0	20	37	52	58	61	65	0
UATYQ700	ECONO700	8300	3.92	0	5	10	13	20	32	42	15

Pressure drop in economiser kit from table 2 refers to initial resistance. An air filter that is installed in the rain hood of economiser will expose to outdoor environment and easily becomes dirty. Regular service is required for this filter (recommended at least once every two weeks). The final resistance shall not exceed the recommended value in table 3 below.

Table 3: Technical specifications for air filter in economiser rain hood.

Economiser Kit Model	Recommended Type	Quantity	Dimension (L x W x t)	* Initial Resistance (Pa)	Recommended Final Resistance
UATYQ250	Washable Saranet Filter	1	750 x 515 x 4	15	80
UATYQ350	Washable Saranet Filter	1	658 x 560 x 4	13	70
UATYQ450	Washable Saranet Filter	1	658 x 560 x 4	27	70
UATYQ550	Washable Saranet Filter	1	750 x 604 x 4	34	110
UATYQ600	Washable Saranet Filter	1	750 x 604 x 4	30	105
UATYQ700	Washable Saranet Filter	1	1088 x 690 x 4	16	110

Note: * Initial resistance is rated based on 85% of outdoor air opening.

The resistance values mentioned in table 3 have been incorporated into pressure drop values in table 2.

Table 3 provides guidelines only on the service of filter. Thus, system sizing does not require to include these values into consideration.

Optional Air Filter

There is a 2" filter slot inside the unit. Optional filter (field supplied) is recommended as the second layer filtration since outdoor air damper opening may bring in dust and dirt. In order to ensure that final resistance of the filter not exceed recommended values, service the filter every 2 weeks or more frequent if necessary.

Limitation Of Economiser Kit In Thermostat Control

Thermostat control is used with third party controller and thus the setting temperature of specific application cannot be known. For this case, it is recommended to use remote controller to set the required setting temperature before the hardware setting for thermostat control is conducted. The minimum fresh air opening for fan mode in thermostat control operation shall follow the user's selection in hardware setting (Dip Switch 1 and Dip Switch 2), whichever is lower. Note: Refer to hardware setting guideline provided in part (v) under chapter 'control operation guide' in installation manual for mode selection.

Necessary For Pressure Relief



Presence of fresh air may cause building pressure rises and bring discomfort to the users. When necessary, it is recommended to install a relief damper or exhaust fan in the return air duct. The relief damper may be a gravity type or motorized type. It is used to maintain building pressurization by regulating the flow of relief air from the building. For most bulding, the maximum pressure is not to exceed 25Pa.

8 Dimensional drawings


8 - 1 Dimensional Drawings

UATYQ250CY1



All dimensions are in mm

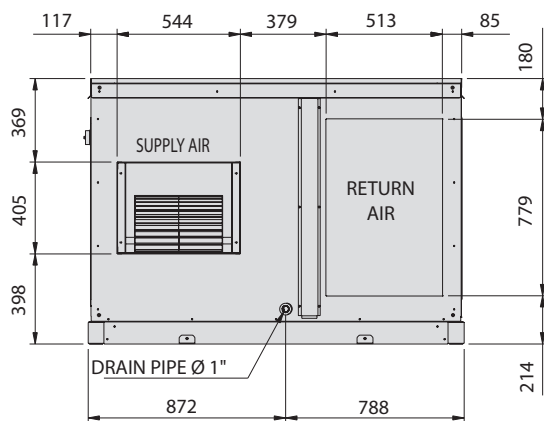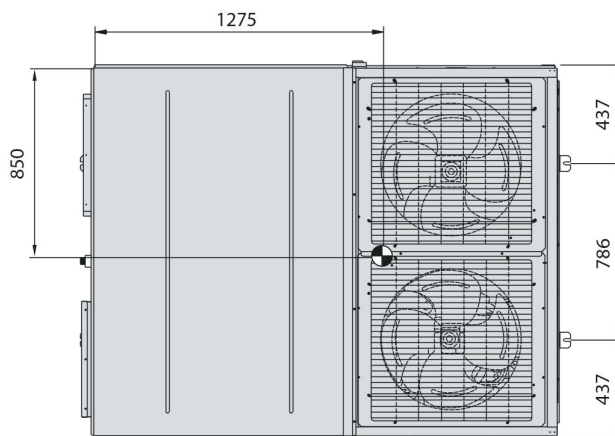

FOR HORIZONTAL DISCHARGE

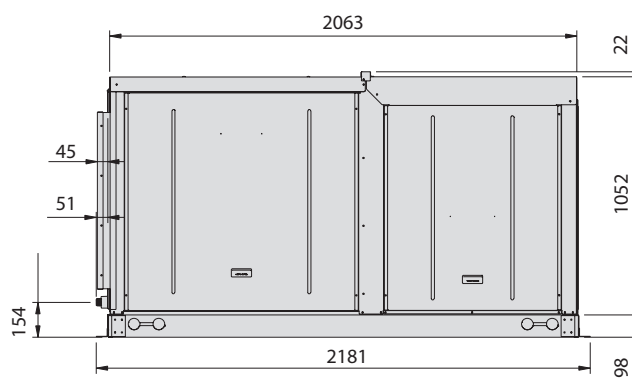

Back view of the unit:

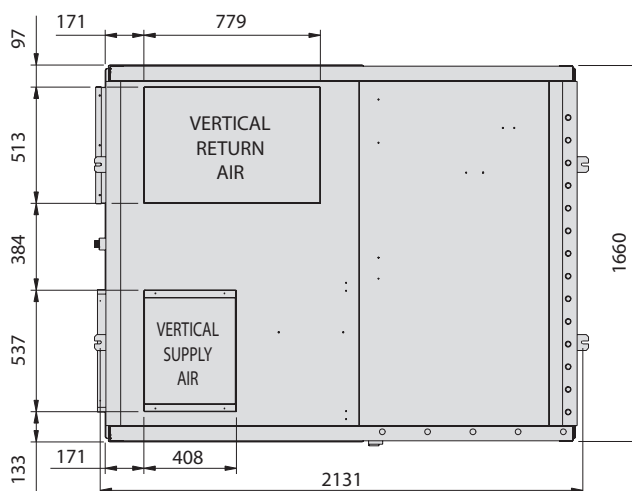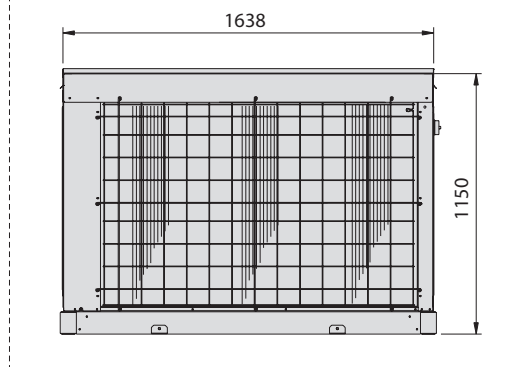


FOR VERTICAL DISCHARGE

UATYQ250-700CY1_IM

26


All dimensions are in mm

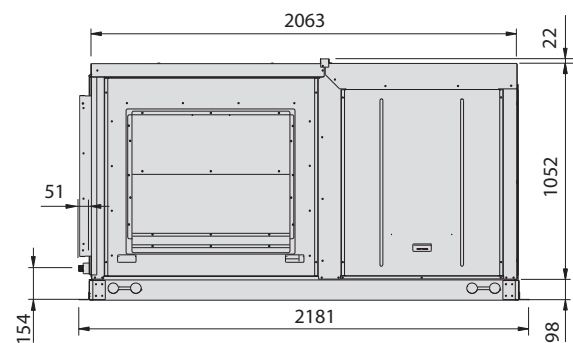

Back view of the unit:

Technical drawing of the back view of the unit. The drawing shows a rectangular unit with a grid-like structure. Dimensions are indicated as follows:

- Overall width: 1638
- Overall height: 1150
- Distance from the left edge to the start of the grid: 522
- Distance from the top edge to the start of the grid: 277
- Distance from the bottom edge to the start of the grid: 672
- Distance from the left edge to the start of the grid (including a small offset): 223

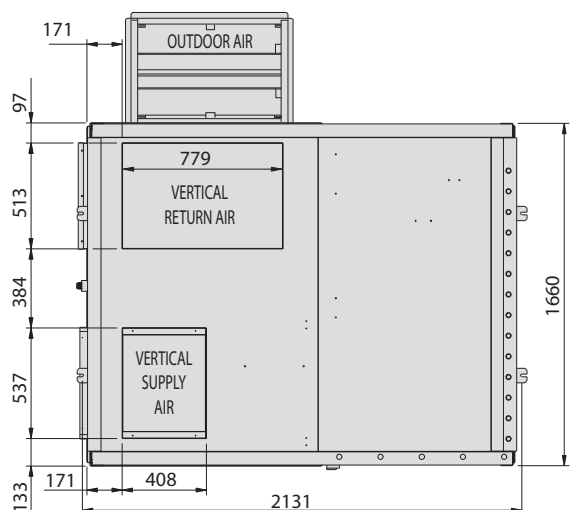


UATYQ250-700CY1_IM

8 Dimensional drawings

8 - 1 Dimensional Drawings


UATYQ350CY1

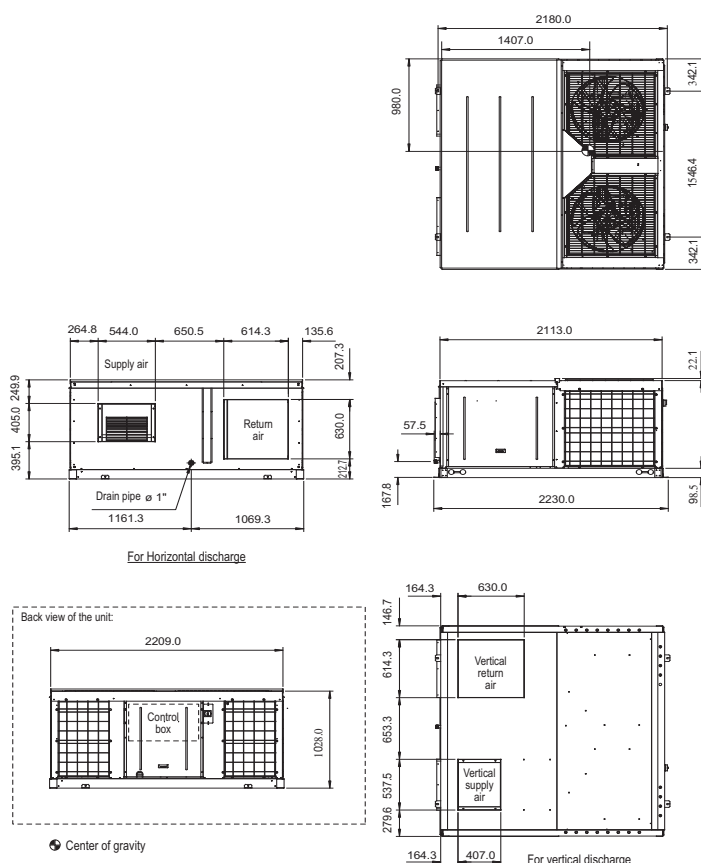

NOTES

- All dimensions are in mm

UATYQ450CY1

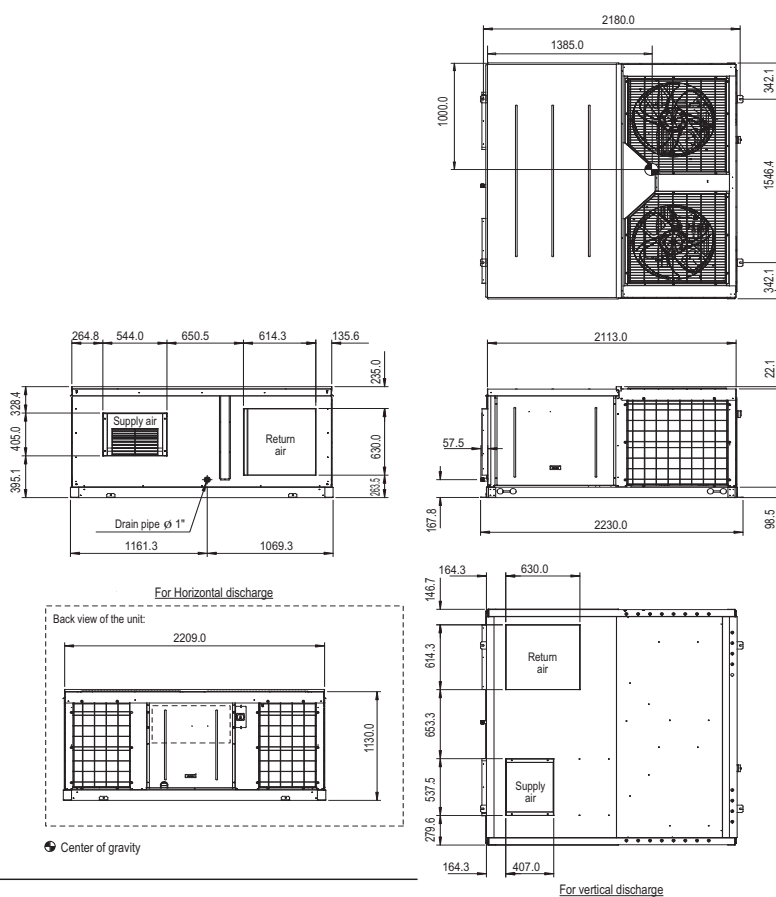


NOTES

- All dimensions are in mm

8 Dimensional drawings

8 - 1 Dimensional Drawings


UATYQ550,600,700CY1

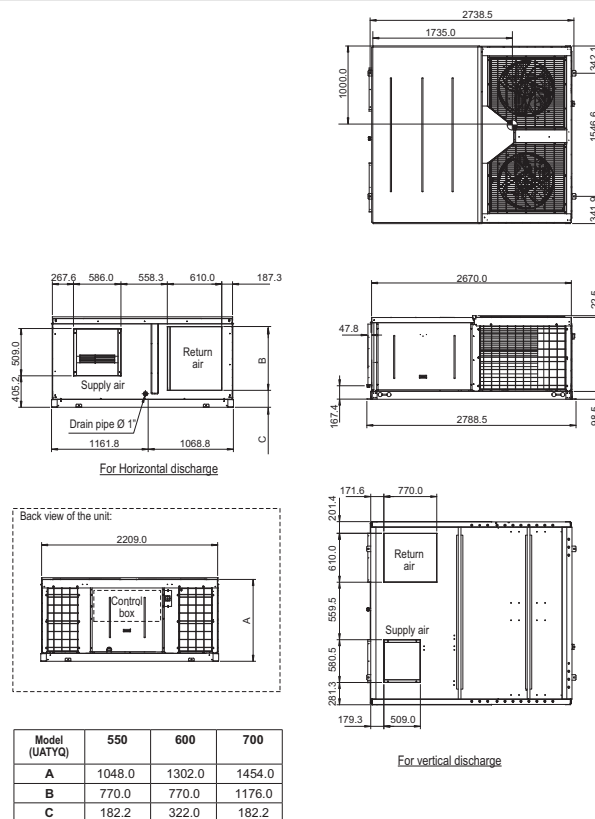

NOTES

- All dimensions are in mm

UATYQ900CY1

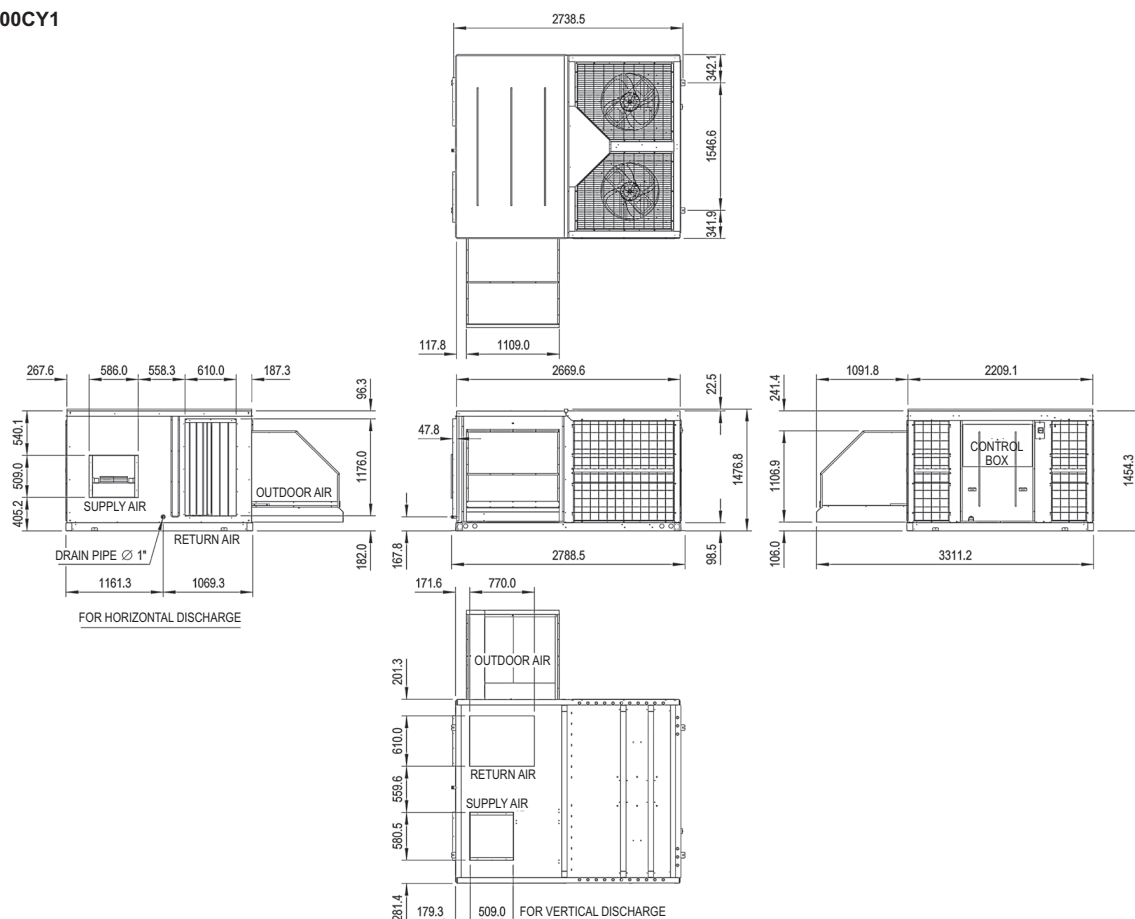


8 Dimensional drawings

8 - 1 Dimensional Drawings

UATYQ-CY1

Unit conversion

In the case of converting standard unit to downthrow unit, follow the steps as stated below: **UATYQ250, 350, 450, 550, 600, 700 & 900**

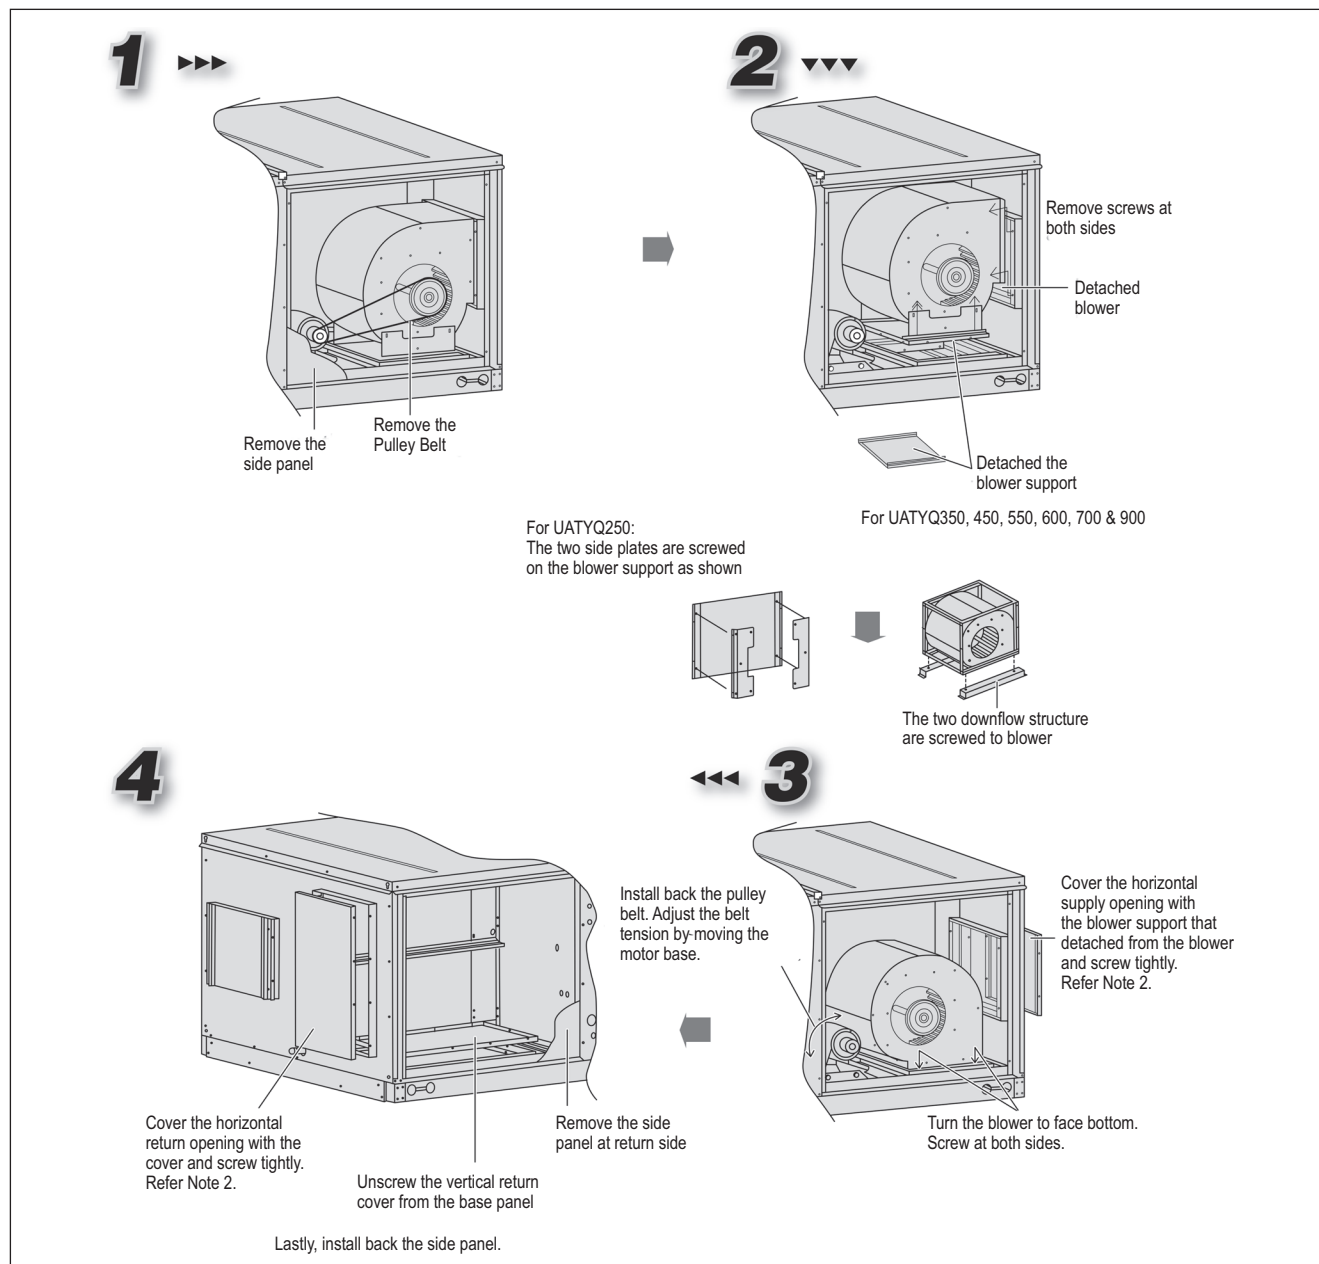

Install back the pulley belt. Adjust the belt tension. Lastly, install back the side panel. Refer Note 1.

NOTES

- For downthrow conversion, belt length need to be changed.
For unit with standard pulley, belt length = a mm
Shaft to shaft distance for downthrow, C-C = b mm

	UATYQ250	UATYQ350	UATYQ450	UATYQ550	UATYQ600	UATYQ700	UATYQ900
a	1432	1457	1382	1500	1500	1500	1500
b	425	430	345	420	420	440	440

- Sealant such like gasket (field supply) shall be placed in between the metal cover and flange. Besides that, weatherproof silicone shall be applied on all the joints, screw holes and gaps to ensure water-tight condition.
- Refer Engineering Data Book for blower curve and technical data of variable pitch pulley.

UATYQ250-900CY1_IM



8 Dimensional drawings

8 - 1 Dimensional Drawings

UATYQ250-900CY1


Unit Support (For down throw unit only)

- The figure shows the use of the roof curb for mounting these units.
- The curb should be sealed and fixed to the roof by weather stripping. A suggested means of sealing the unit and roof curb as shown in the right.
- Recommended roof curb dimension is shown below.

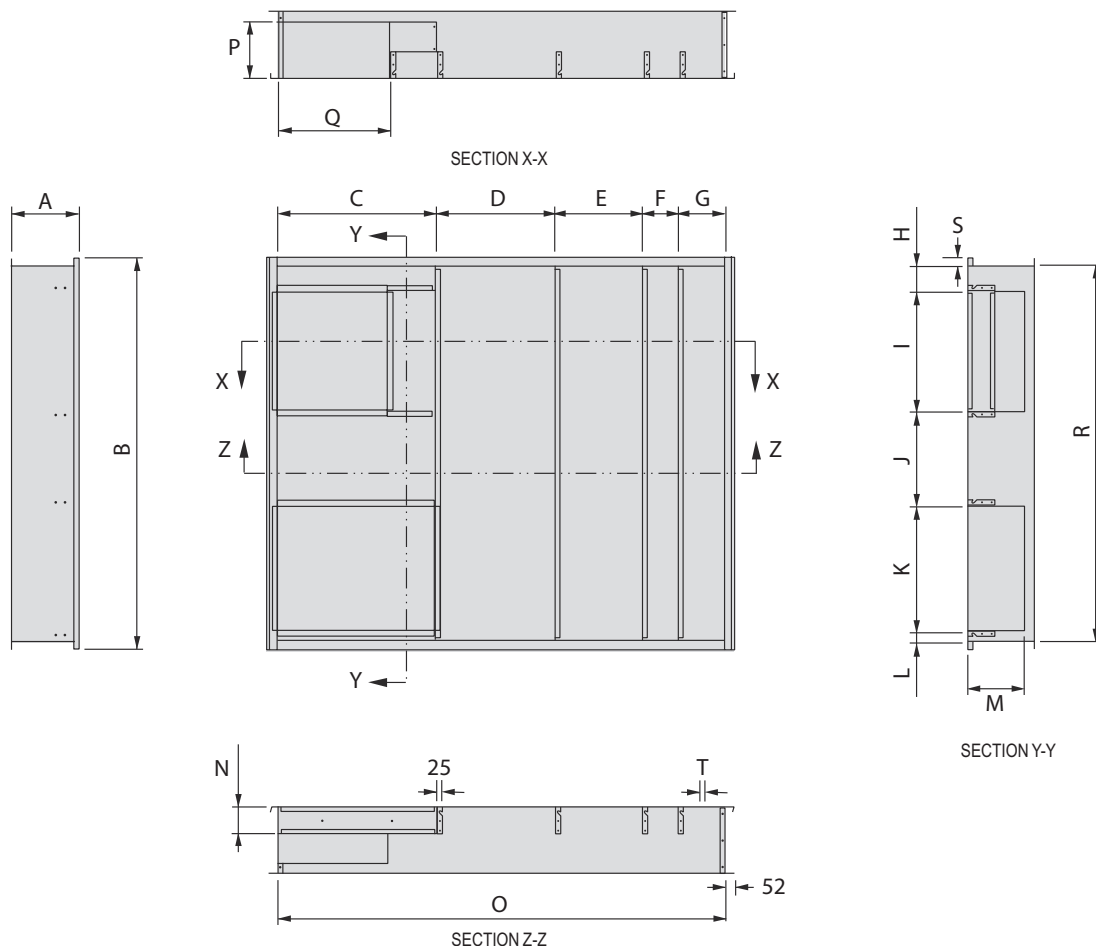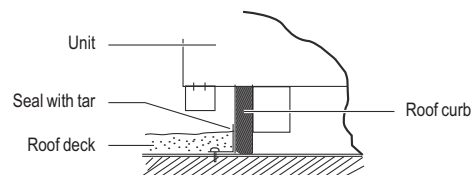

Model (UATYQ)	250	350/450	550/600/700/900
A	355	355	355
B	1506	2081	2081
C	840	700	840
D	315	410	625
E	315	410	462
F	0	0	190
G	314	287	248
H	0	131	131
I	607	600	646
J	322	544	495
K	540	682	676
L	0	42	51
M	300	300	300
N	141	141	141
O	1784	1908	2365
P	300	300	300
Q	481	477	590
R	1469	1998	1998
S	20	41.5	41.5
T	20	41.5	41.5


Note: All dimensions are in mm

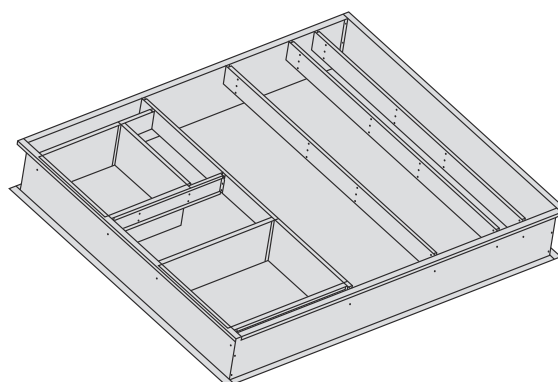

UATYQ250-900CY1_IM

9 Piping diagrams

9 - 1 Piping Diagrams

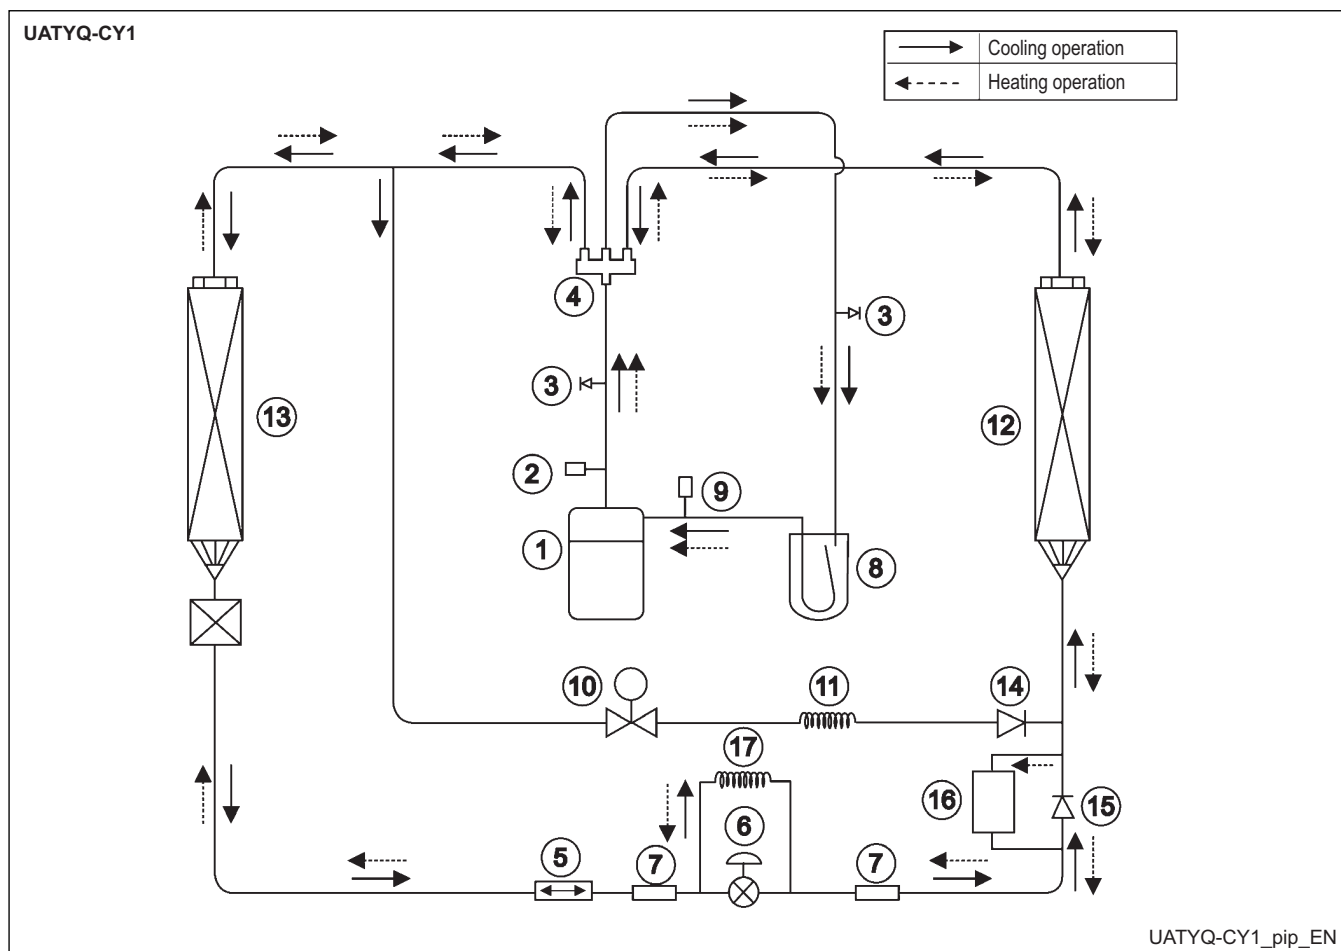


10 Wiring diagrams

10 - 1 Wiring Diagrams - Single Phase


UATYQ250-900CY1

A Control Module UATYQ250

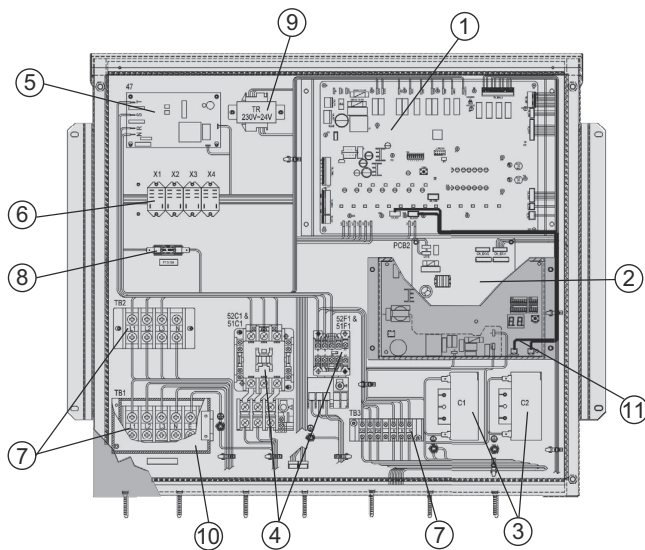


No.	Item Description
①	Controller Main Board
②	EXV Controller Board
③	Capacitor
④	Contactor
⑤	Phase Protector
⑥	Relay
⑦	Terminal Block
⑧	Fuse
⑨	Transformer
⑩	Terminal Block Cover
⑪	Economiser Controller Board

B Control Module UATYQ350/450/550

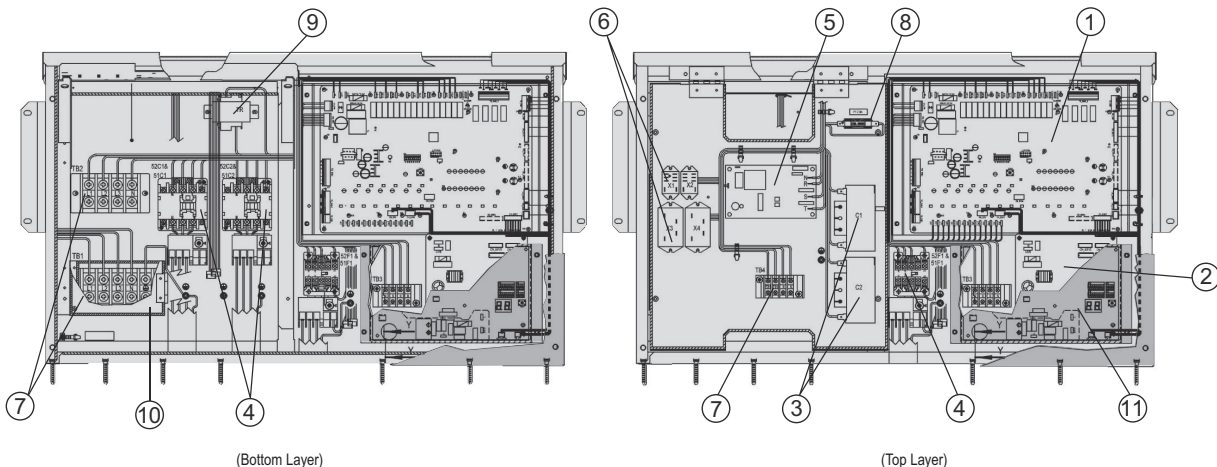

C Control Module UATYQ600/700/900

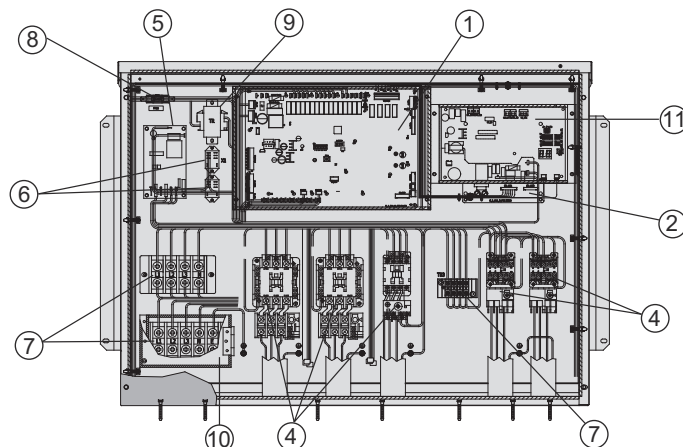

NOTES

Item 11 (Economiser Controller Board) shall be used together with the economiser kit which is provided separately as the accessory.

UATYQ250-900CY1_controlmodule_EN

10 Wiring diagrams

10 - 2 Wiring Diagrams - Three Phase

UATYQ250CY1


Power Supply
380~415VAC
3N-PE
50Hz

NOTES


1. The dotted lines show field wiring.
2. The figure in the parenthesis show field supply parts.
3. Color of earth wire is yellow and green twisting.
4. Specification subject to change without notice.

Caution,

1. To protect Indoor Fan motor from abnormal current, Over Current Relay <51F>, is installed. Therefore, do not change factory set value of the Over Current Relay.

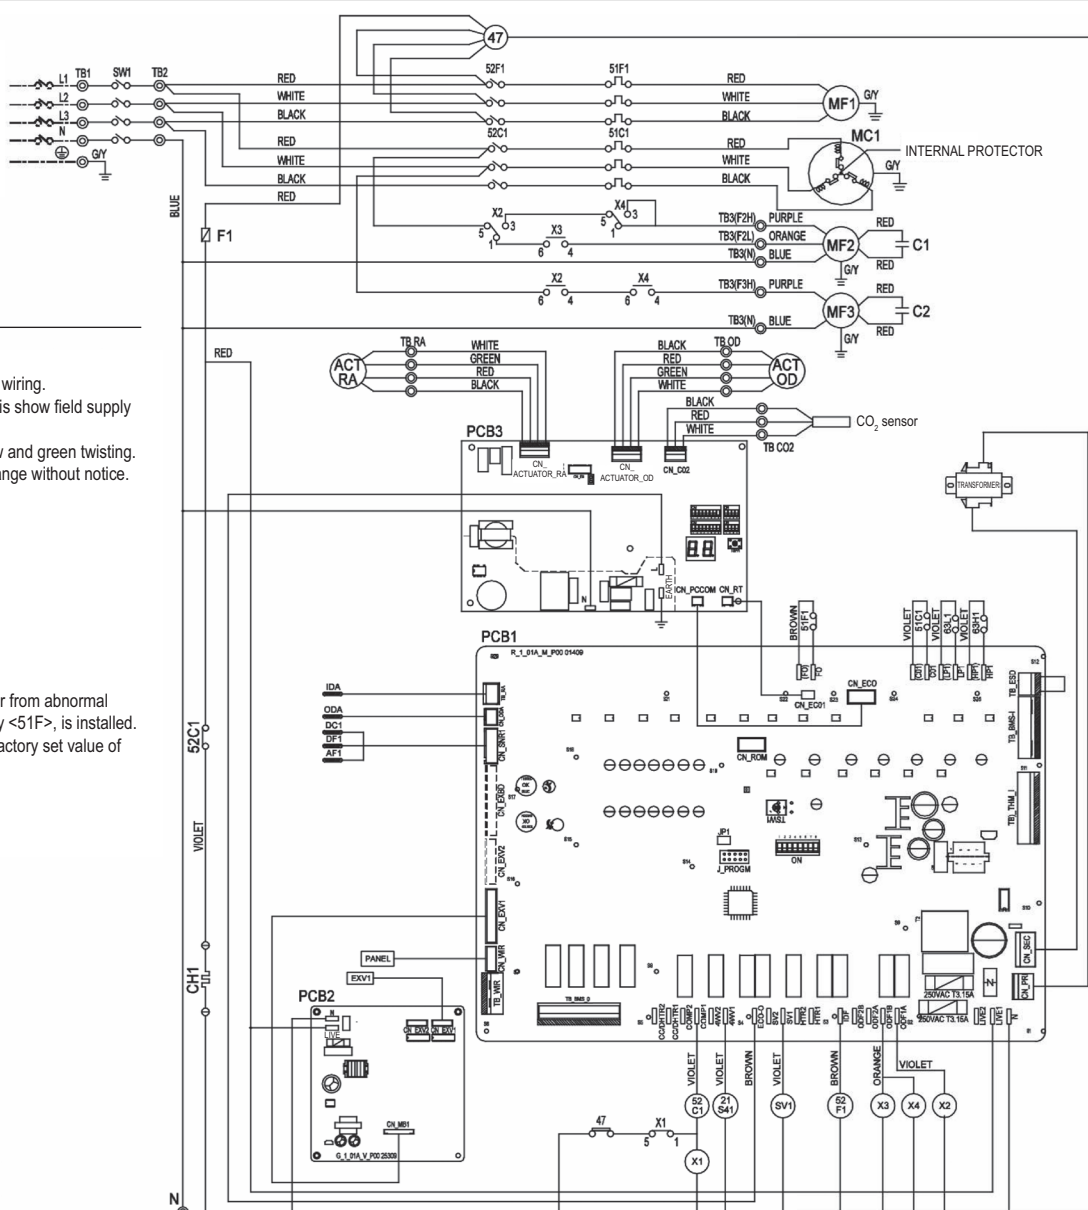

ARRANGEMENT

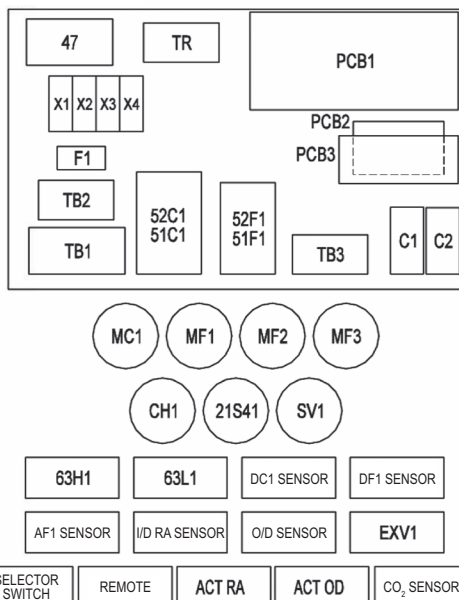

SYMBOL	NAME
MC1	Compressor Motor
MF1	Fan Motor (Indoor)
MF2.3	Fan Motor (Outdoor)
52C1	Contactor (Compressor)
52F1	Contactor (Fan I/D)
51C1	Over Current Relay (Compressor)
TB1,2,3/ TB RA,OD,C0	Terminal Block
F1	Fuse
51F1	Over Current Relay (Fan I/D)
CH1	Crankcase Heater
47	Phase Protector
63H1	High Pressure Switch
63L1	Low Pressure Switch
C1, C2	Capacitor (O/D Fan Motor)
SV1	Solenoid Coil
21S41	4-Way Valve
X1,X2,X3,X4	Auxiliary Relays
TR	Transformer 230V/24V
TB_RA	I/D Return Air Sensor
CN_ODA	O/D Air Sensor
CN_SNR1	Sensor DC1, DF1 & AF1
CN_EXV1	Expansion Valve
CN_WIR	Panel Remote Controller
PCB 1&2	Control Module 5RT90BR
PCB 3	Control Module Economizer
CN_ACT_RA	Return Air Actuator
CN_ACT_OD	Outdoor Actuator
CN CO ₂	Carbon Dioxide Sensor

10 Wiring diagrams

10 - 2 Wiring Diagrams - Three Phase

UATYQ350-550CY1


Power Supply
380~415VAC
3N-PE
50Hz

NOTES


1. The dotted lines show field wiring.
2. The figure in the parenthesis show field supply parts.
3. Color of earth wire is yellow and green twisting.
4. Specification subject to change without notice.

Caution,



1. To protect Indoor Fan motor from abnormal current, Over Current Relay <51F>, is installed. Therefore, do not change factory set value of the Over Current Relay.

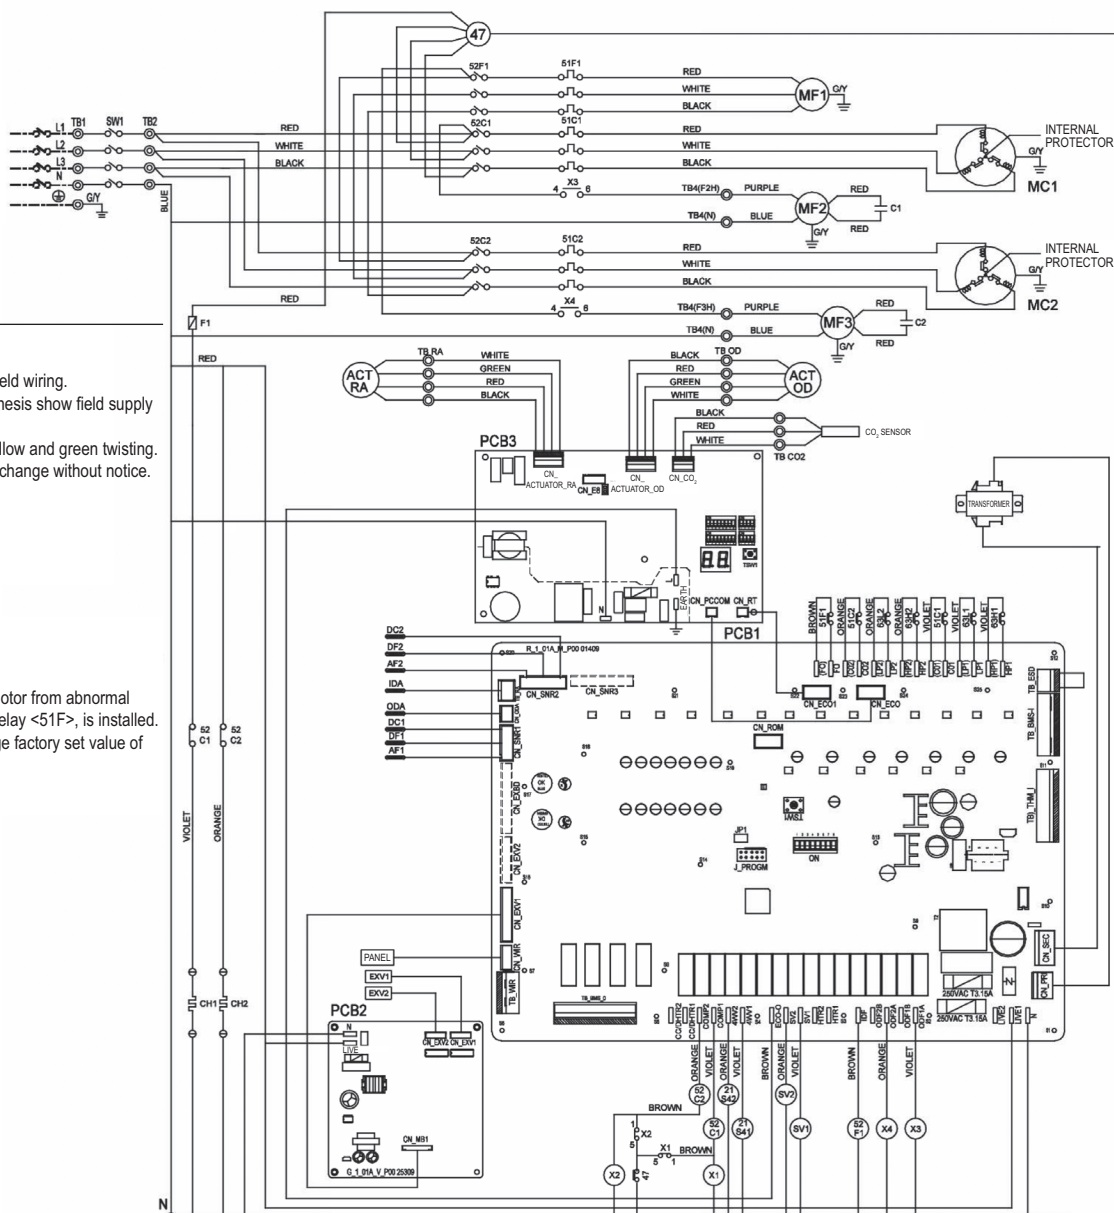

ARRANGEMENT TOP

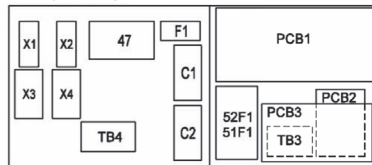



ARRANGEMENT BOTTOM

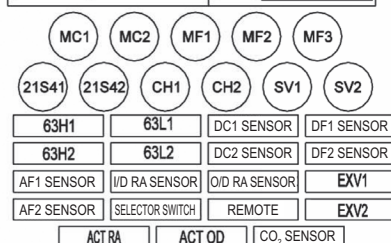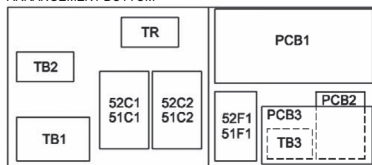

SYMBOL	NAME
MC1/MC2	Compressor Motor
MF1	Fan Motor (Indoor)
MF2,3	Fan Motor (Outdoor)
52C1/52C2	Contact (Compressor)
52F1	Contact (Fan I/D)
51C1/51C2	Over Current Relay (Compressor)
TB1,3,4 / TB RA,OD,CO ₂	Terminal Block
F1	Fuse
51F1	Over Current Relay (Fan I/D)
CH1/CH2	Crankcase Heater
47	Phase Protector
63H1/63H2	High Pressure Switch
63L1/63L2	Low Pressure Switch
C1, C2	Capacitor (O/D Fan Motor)
SV1/SV2	Solenoid Coil
21S41/21S42	4-Way Valve
X1,X2,X3,X4	Auxiliary Relays
TR	Transformer 230V/24V
TB_RA	I/D Return Air Sensor
CN_ODA	O/D Air Sensor
CN_SNR1	Sensor DC1, DF1 & AF1
CN_SNR2	Sensor DC2, DF2 & AF2
CN_EXV1 /CN EXV2	Expansion Valve
CN_WIR	Panel Remote Controller
CN_ACT_RA	Return Air Actuator
CN_ACT_OD	Outdoor Actuator
CN CO ₂	Carbon Dioxide Sensor

10 Wiring diagrams

10 - 2 Wiring Diagrams - Three Phase

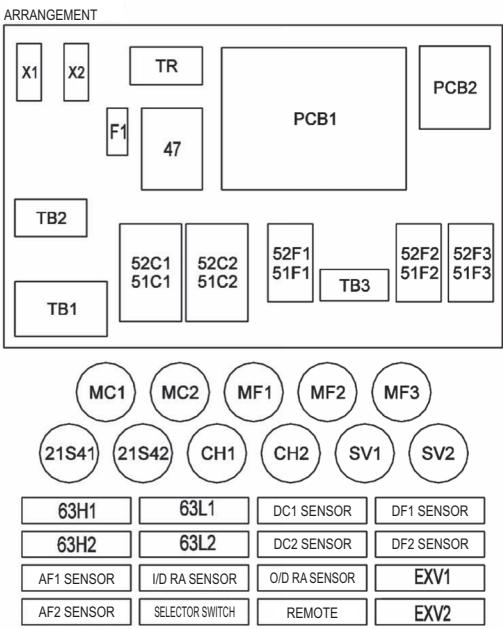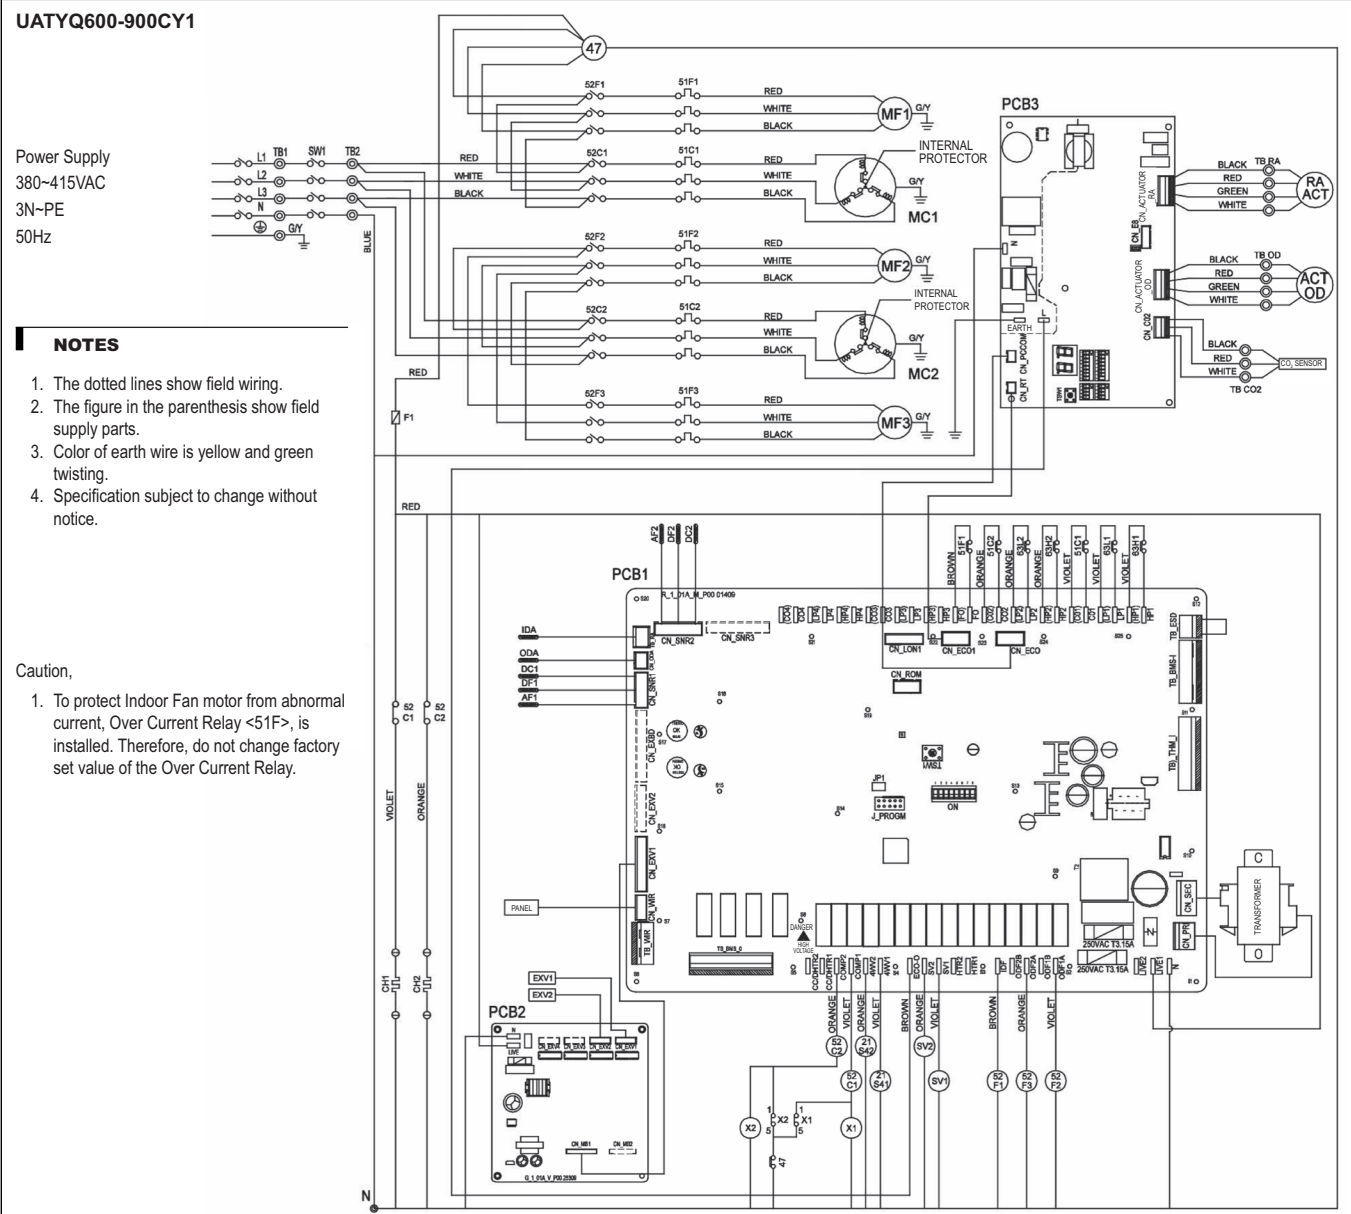

SYMBOL	NAME
MC1/MC2	Compressor Motor
MF1	Fan Motor (Indoor)
MF2,3	Fan Motor (Outdoor)
52C1/52C2	Contacteur (Compressor)
52F1	Contacteur (Fan I/D)
51C1/51C2	Over Current Relay (Compressor)
TB1,2,3	Terminal Block
F1	Fuse
51F1	Over Current Relay (Fan O/D)
CH1/CH2	Crankcase Heater
47	Phase Protector
63H1/63H2	High Pressure Switch
63L1/63L2	Low Pressure Switch
SV1/SV2	Solenoid Coil
21S41/21S42	4-Way Valve
X1,X2	Auxiliary Relays
TR	Transformer 230V/24V
TB_RA	I/D Return Air Sensor
CN_ODA	O/D Air Sensor
CN_SNR1	Sensor DC1, DF1 & AF1
CN_SNR2	Sensor DC2, DF2 & AF2
CN_EXV1 /CN EXV2	Expansion Valve
CN_WIR	Panel Remote Controller
PCB1&2	Controller Module 5RT210BR
PCB3	Controller Module Economizer
CN_ACT_RA	Return Air Actuator
CN_ACT_OD	Outdoor Actuator
CN CO ₂	Carbon Dioxide Sensor

11 Sound data

11 - 1 Sound Level Data

11



UATYQ250-900CY1

Model	1/1 Octave Sound Pressure Level (dB, ref 20μPa)								Overall dB(A)	Noise Criteria (NC)
	63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz		
UATYQ250CY1	77	76	64	65	63	60	55	48	68	66
UATYQ350CY1	78	75	62	60	59	54	50	44	64	65
UATYQ450CY1	77	74	61	60	61	54	52	54	65	63
UATYQ550CY1	78	82	66	63	63	56	51	45	68	73
UATYQ600CY1	85	76	69	66	65	61	53	46	70	66
UATYQ700CY1	83	74	70	66	65	62	56	47	70	68
UATYQ900CY1	NA	76	71	66	66	60	55	46	70	66

Model	1/1 Octave Sound Power Level (dB, ref 1pW)								Overall dB(A)
	63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz	
UATYQ250CY1	91	91	79	78	78	72	68	61	82
UATYQ350CY1	96	91	79	78	80	72	70	64	83
UATYQ450CY1	93	90	79	78	80	73	71	64	83
UATYQ550CY1	95	96	83	82	84	78	73	66	87
UATYQ600CY1	101	94	87	85	87	81	76	69	90
UATYQ700CY1	99	91	88	85	86	83	77	69	90
UATYQ900CY1	NA	91	88	87	86	81	78	70	90

11 Sound data

11 - 2 Sound Pressure Spectrum

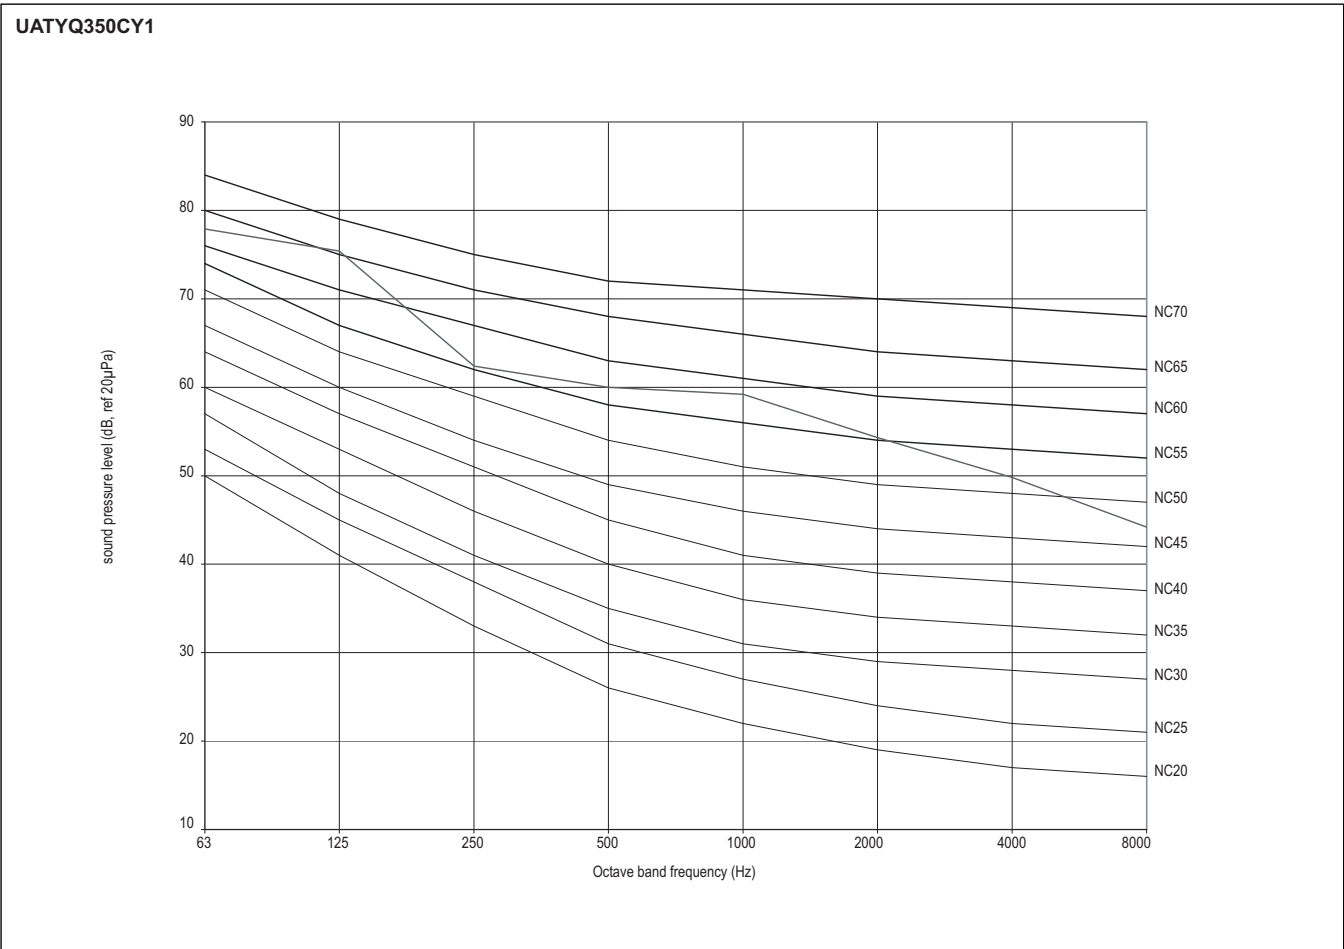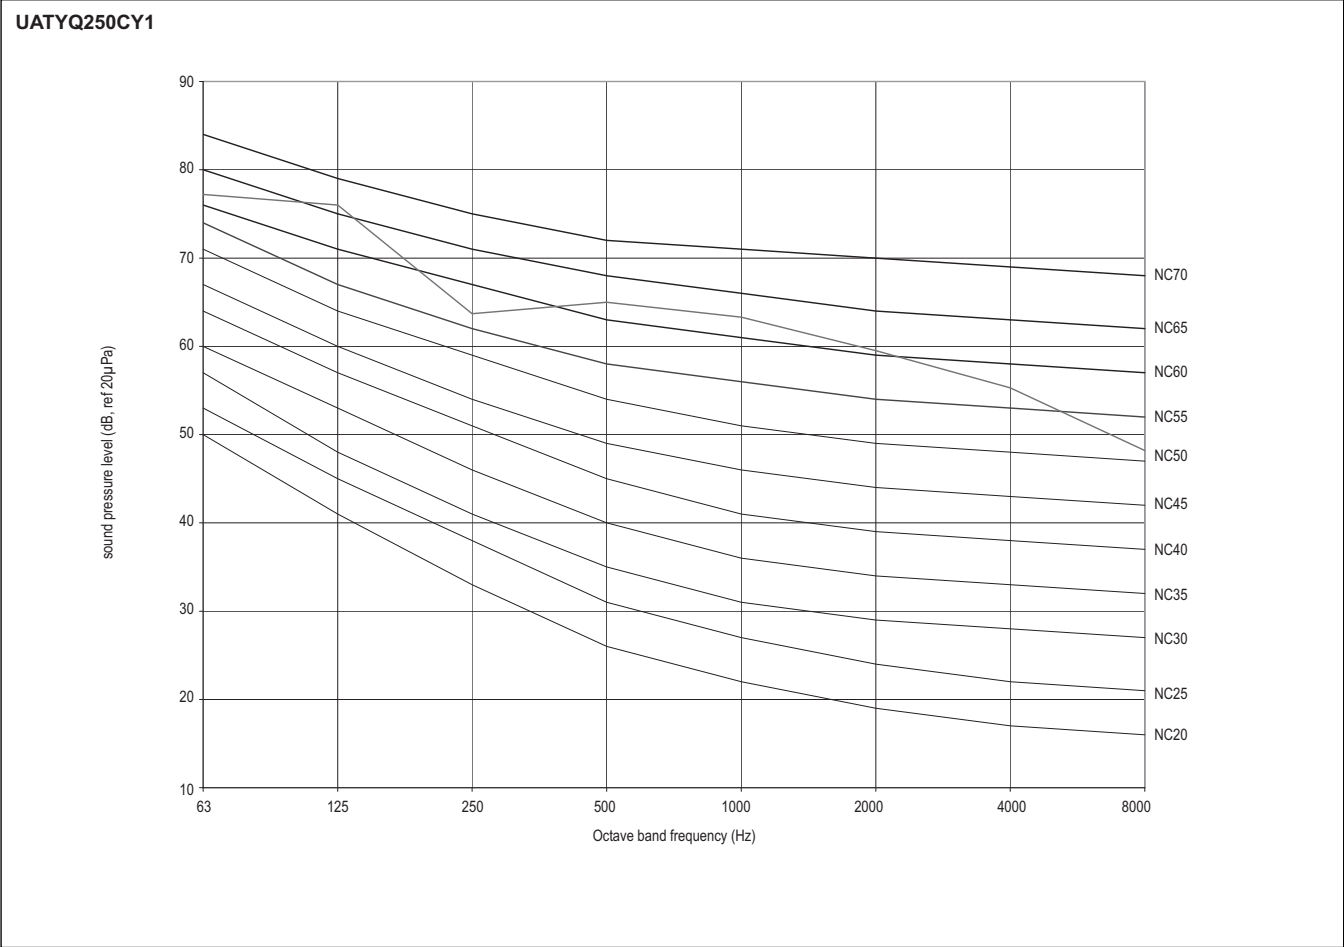


11 Sound data


11 - 2 Sound Pressure Spectrum

11

UATYQ450CY1

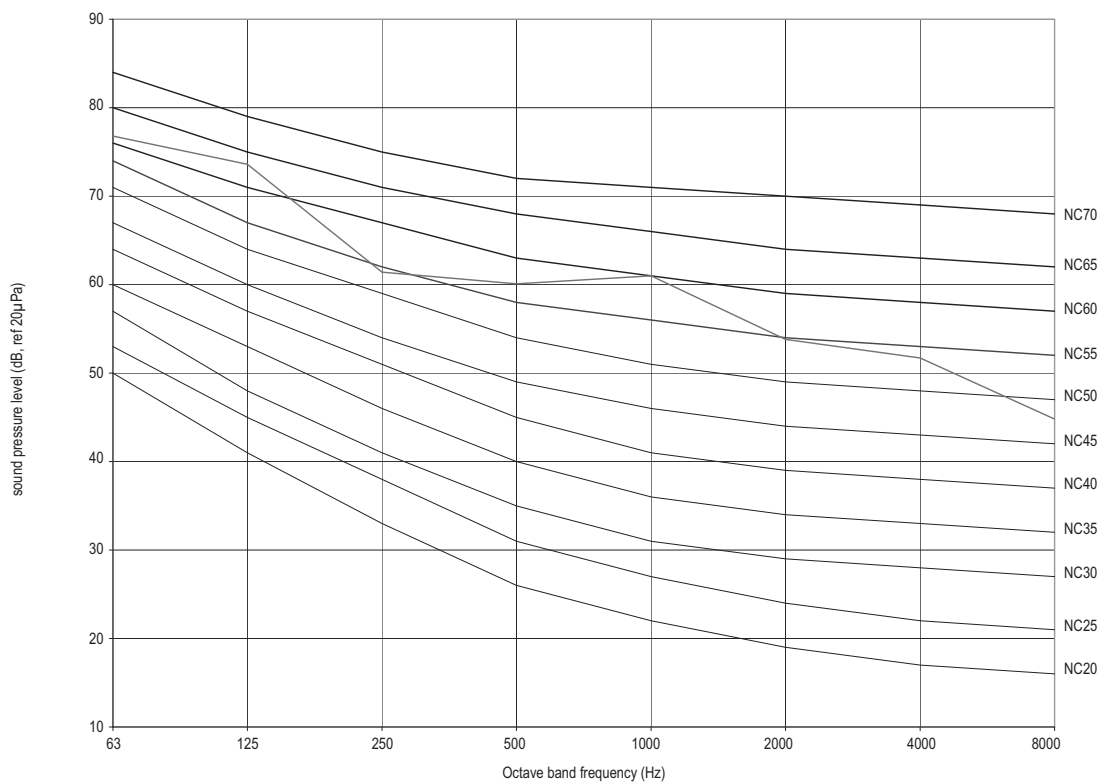


UATYQ550CY1

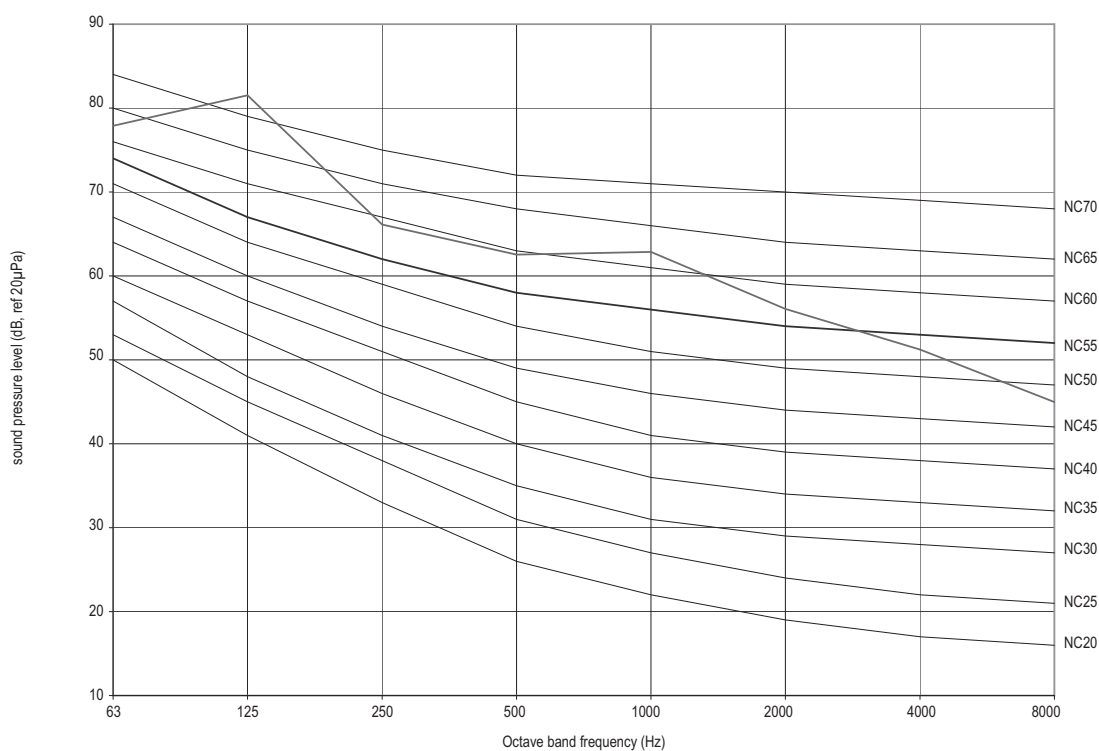


11 Sound data

11 - 2 Sound Pressure Spectrum

UATYQ600CY1

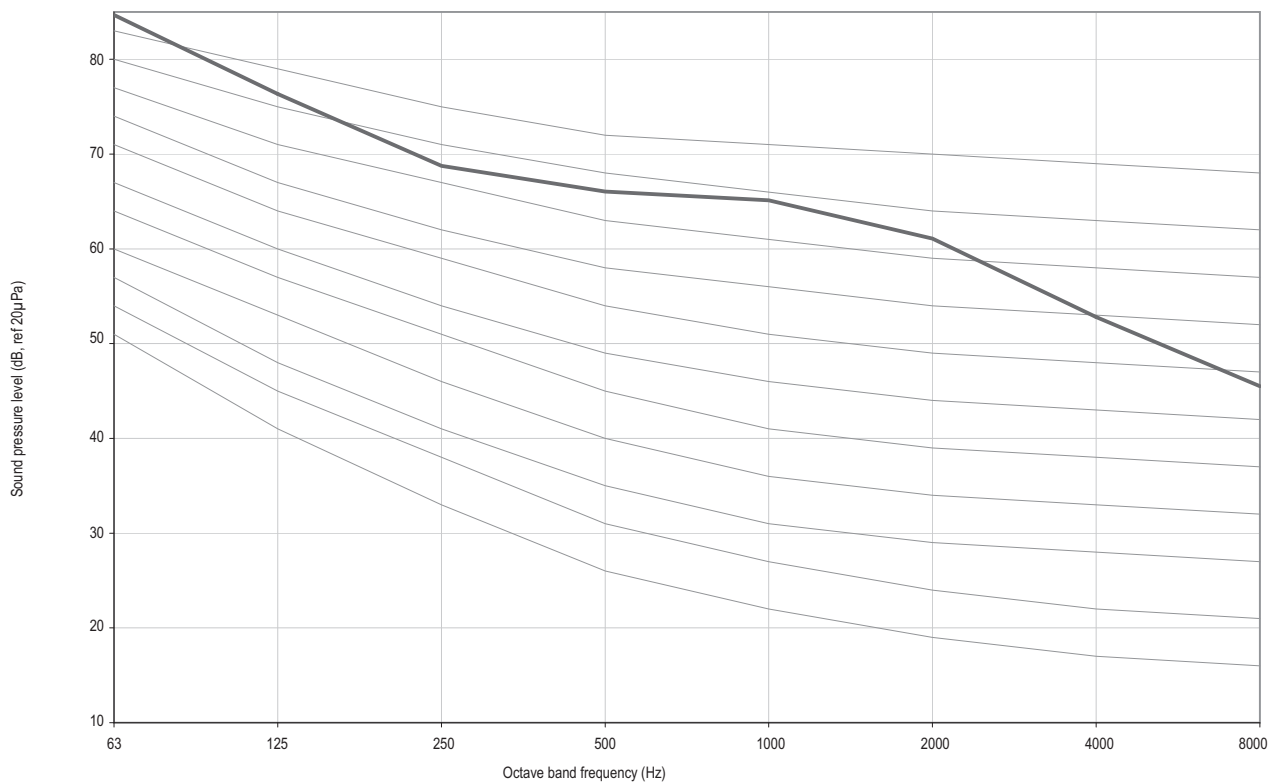


UATYQ700CY1

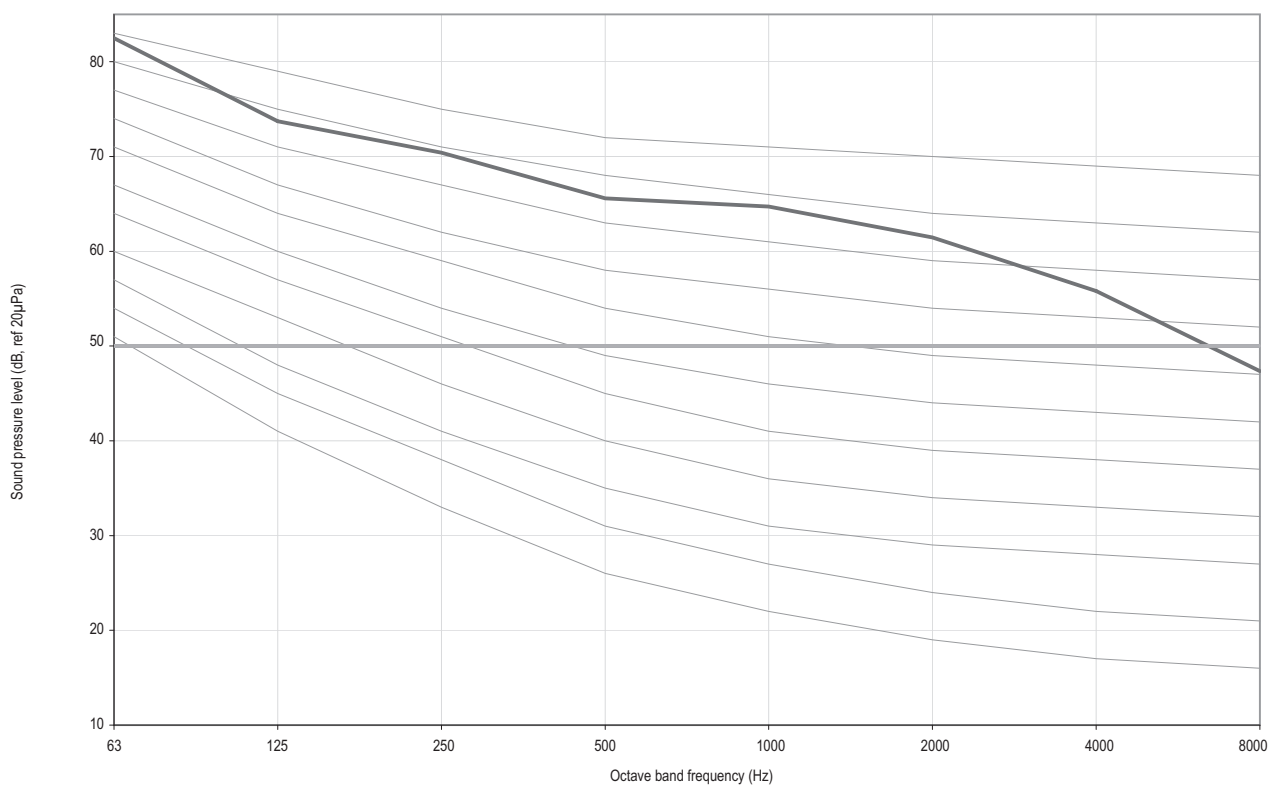

11 Sound data


11 - 2 Sound Pressure Spectrum

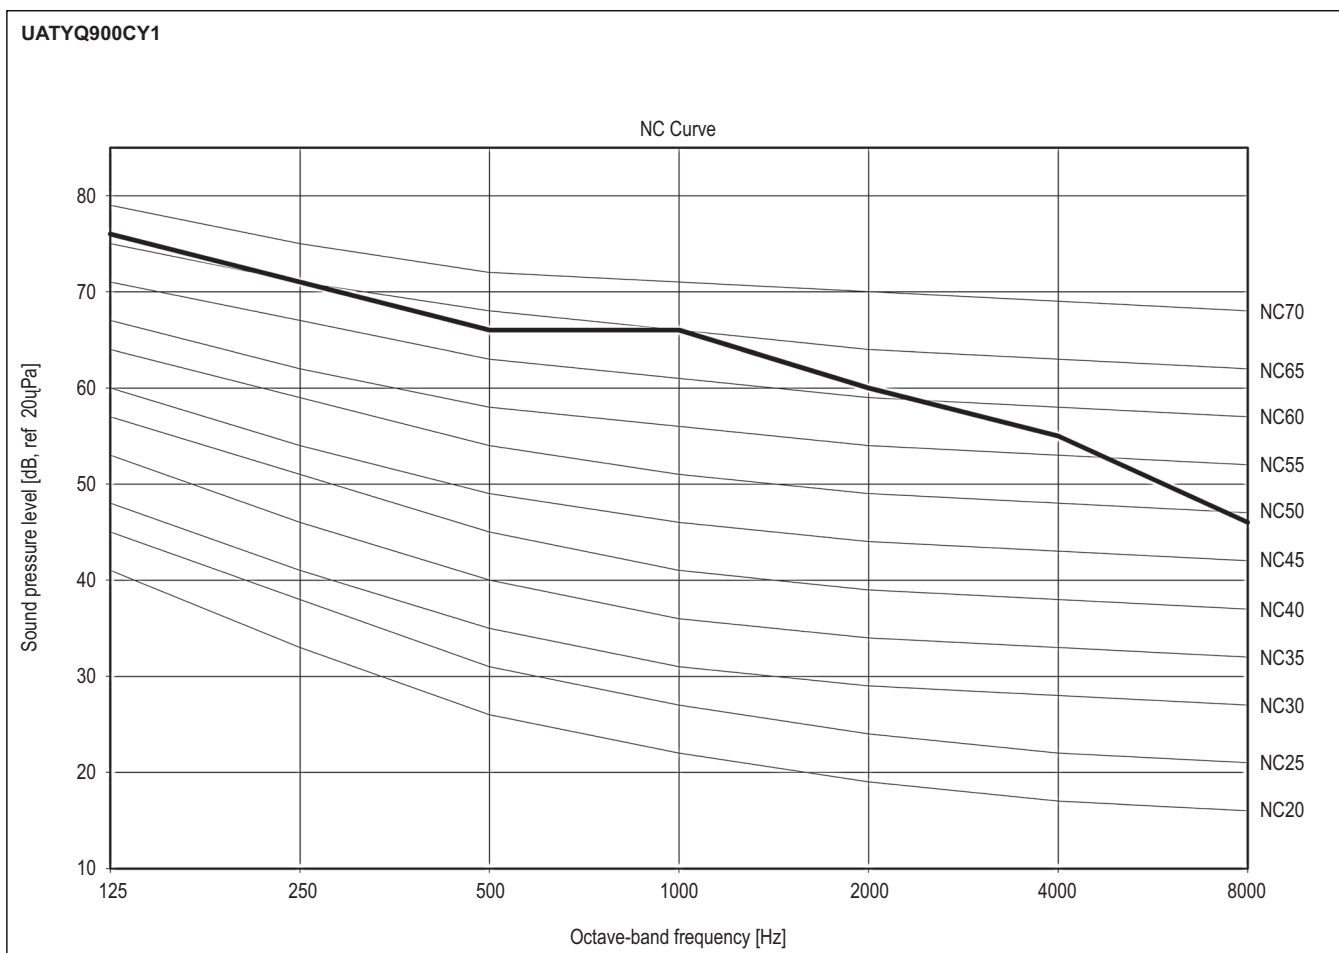


12 Fan characteristics

12 - 1 Fan Characteristics


UATYQ250CY1

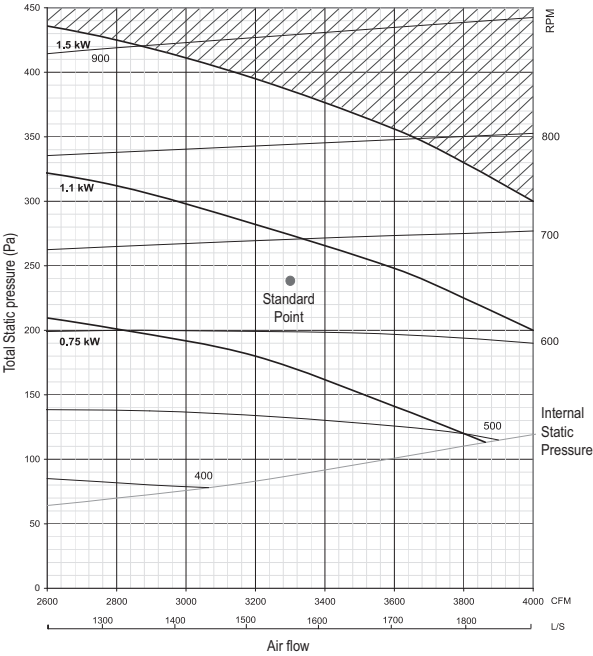


UATYQ350CY1

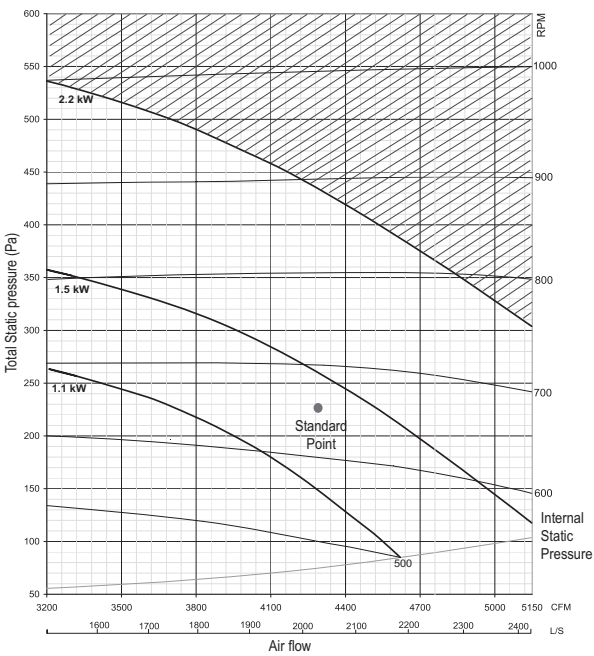

UATYQ450CY1

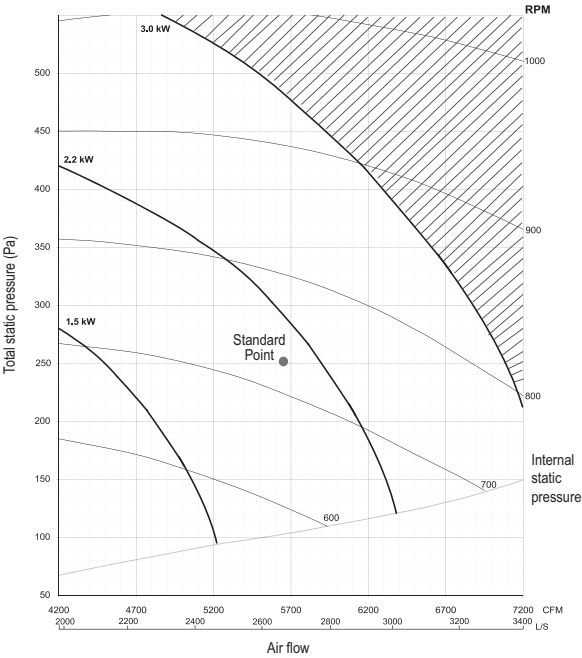

UATYQ550CY1

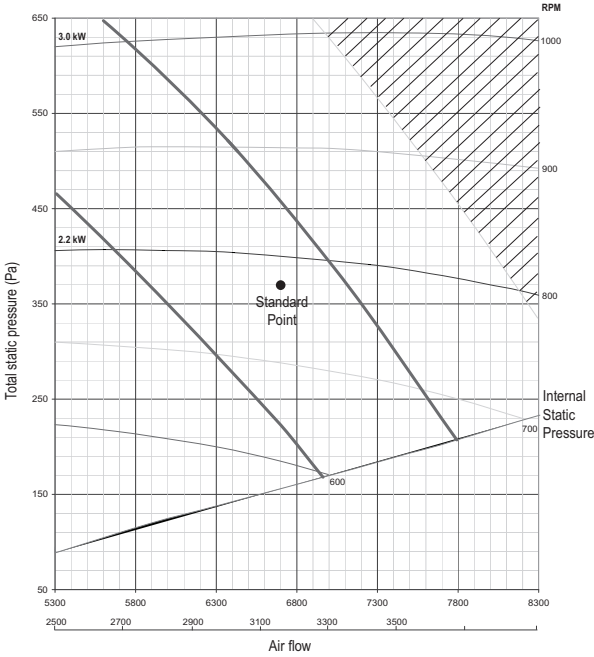


12 Fan characteristics


12 - 1 Fan Characteristics

12


UATYQ600CY1

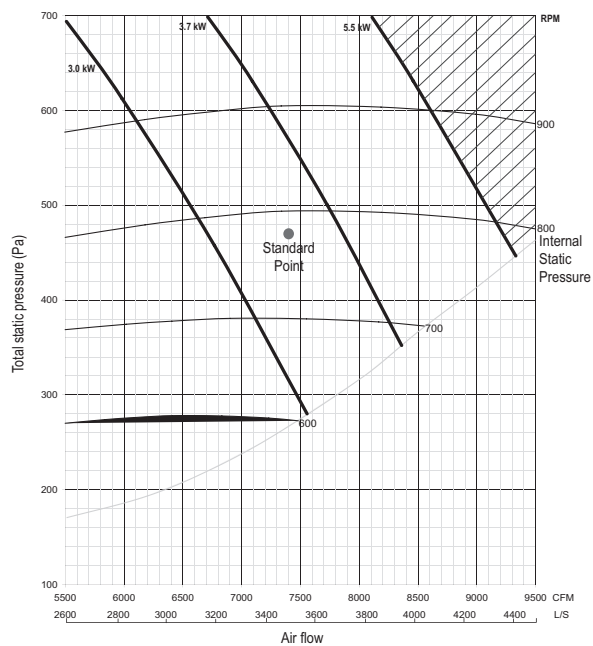

UATYQ700CY1

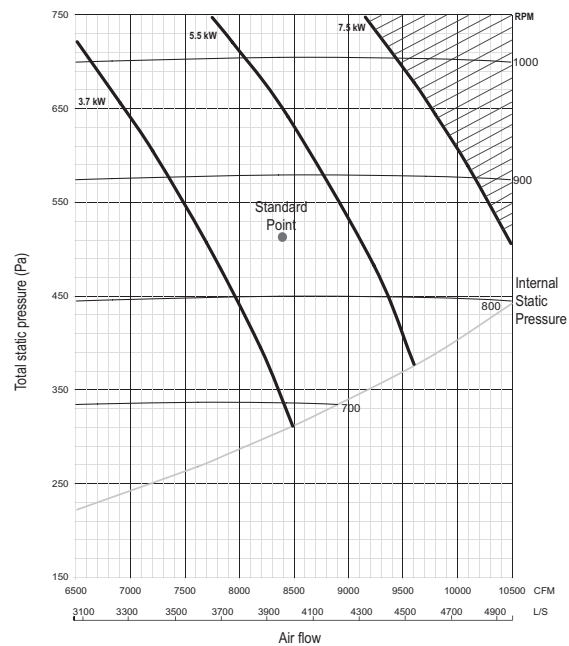

UATYQ900CY1

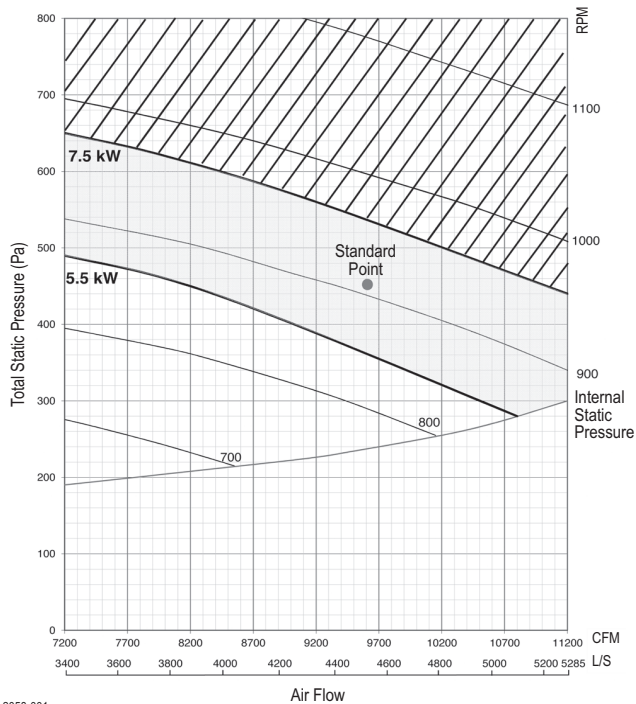

2058-001

VPP06_01_2017

NOTE

The shaded area  indicates the operating range of variable pitch pulley which is used with standard motor (factory fitted). In case if the operation is out of range, change pulley or / and motor size.



13 Installation

13 - 1 Roofcurb

UATYQ250-900CY1


Unit Support (For down throw unit only)

- The figure shows the use of the roof curb for mounting these units.
- The curb should be sealed and fixed to the roof by weather stripping. A suggested means of sealing the unit and roof curb as shown in the right.
- Recommended roof curb dimension is shown below.

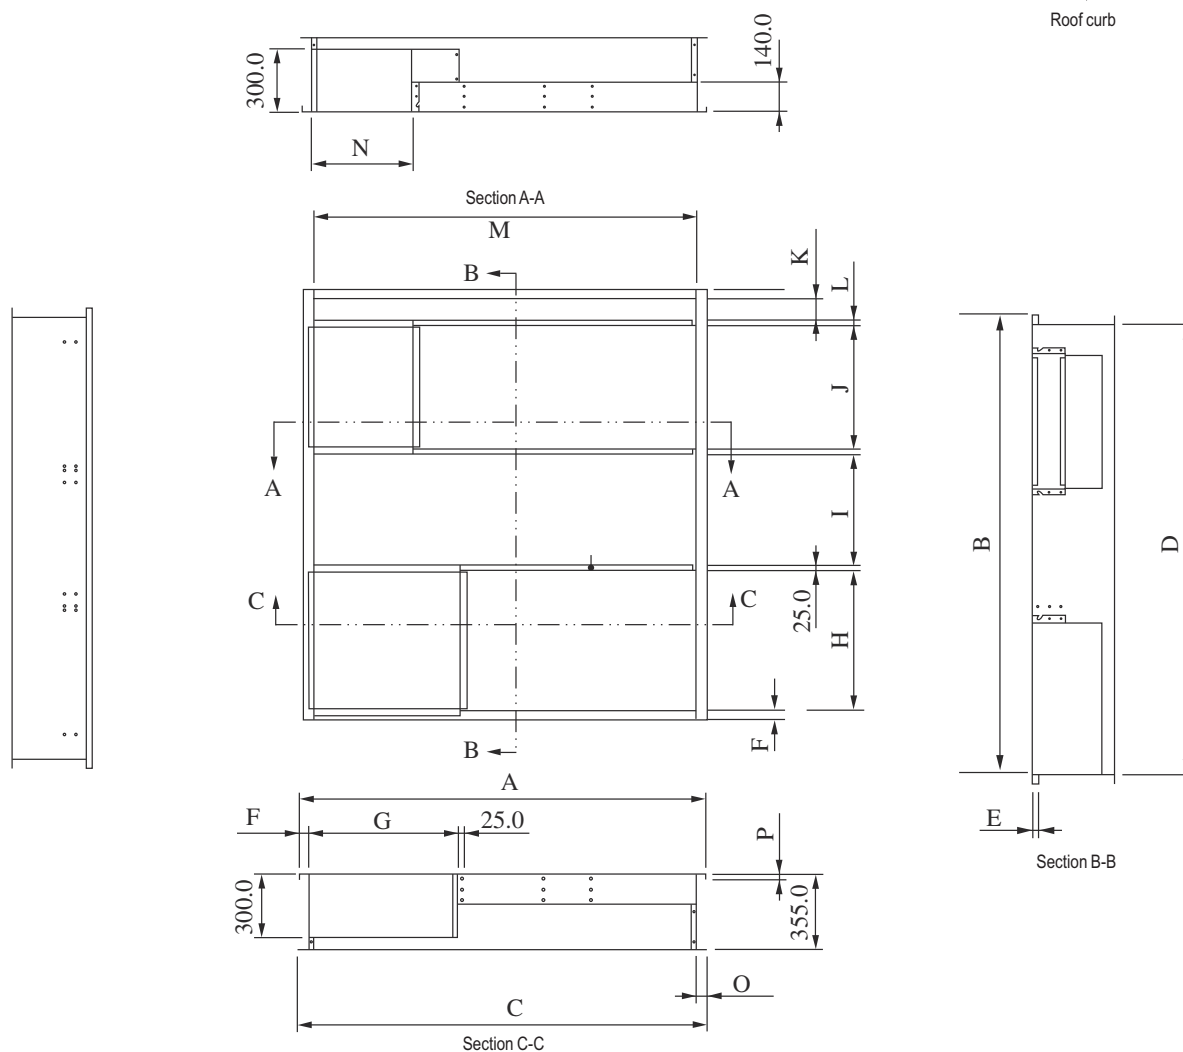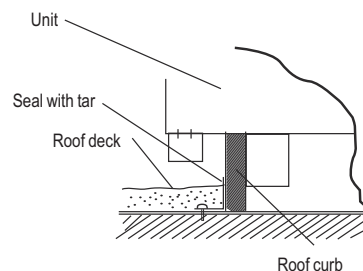

Model (UATYQ)	250	350/450	550/600/700/900
A	1821.0	1890.0	2448.0
B	1505.5	2081.0	2081.0
C	1881.0	1908.0	2466.0
D	1468.5	1998.0	1998.0
E	15.0	25.0	25.0
F	20.0	43.0	46.0
G	838.2	698.7	827.0
H	538.1	676.0	676.0
I	272.4	538.9	444.6
J	605.1	599.8	645.8
K	0.0	104.6	104.6
L	0.0	25.0	25.0
M	1781.0	1804.0	2362.0
N	479.7	475.7	589.0
O	50.0	52.0	52.0
P	15.0	25.0	25.0

Note: All dimensions are in mm

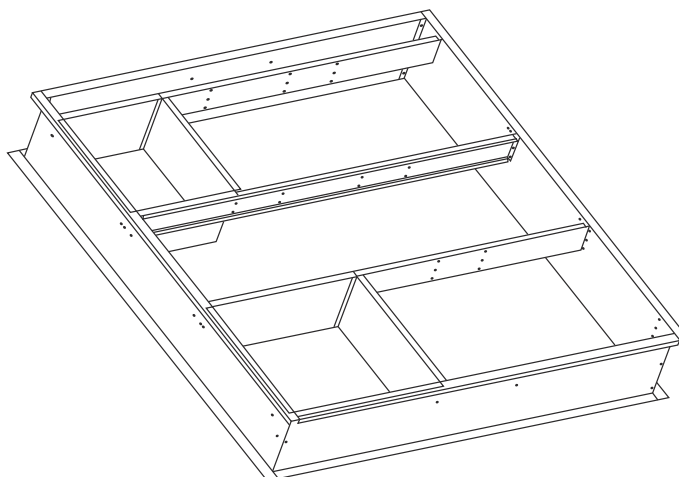

UATYQ250-900CY1_roofcurb_EN

13 Installation

13 - 2 Pulley

13

UATYQ-CY1

TECHNICAL DATA FOR UATYQ-CY1 SERIES WITH VARIABLE PITCH PULLEY:

Motor Variable Pitch Pulley Data:

Date is provided according to factory fitted standard motor and blower. The range of airflow & ESP must be worked **within** blower curve boundary.

External Static Pressure (ESP)		Model 250/350/450/550/600/700/900 = 100Pa																
Models R410A	N	0	0.25	0.5	0.75	1	1.25	1.5	1.75	2	2.25	2.5	2.75	3	3.25	3.5	3.75	4
Rooftop	X	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5	5.5	6	6.5	7	7.5	8	8.5
250	Fan Speed (RPM)	738	733	727	722	716	711	704	698	691	683	676	670	663	656	650	643	638
	Power Input (W)	2005	1950	1890	1830	1770	1715	1660	1605	1550	1490	1420	1350	1275	1205	1130	1060	990
350	Fan Speed (RPM)	760	754	748	741	735	728	721	713	706	699	691	684	676	668	660	652	645
	Power Input (W)	2690	2590	2495	2390	2295	2190	2095	2005	1905	1815	1725	1650	1575	1515	1455	1390	1350
450	Fan Speed (RPM)	820	815	810	805	800	793	787	780	773	765	758	750	742	734	726	718	710
	Power Input (W)	3775	3660	3545	3450	3350	3250	3140	3030	2920	2810	2700	2590	2480	2370	2275	2185	2100
550	Fan Speed (RPM)	890	882	873	864	855	846	837	828	820	811	802	793	784	775	766	757	748
	Power Input (W)	5450	5300	5150	5010	4870	4720	4580	4440	4300	4160	4010	3870	3720	3570	3410	3240	3070
600	Fan Speed (RPM)	889	880	871	862	853	844	835	826	818	810	802	794	786	778	770	762	754
	Power Input (W)	5570	5460	5320	5180	5040	4900	4760	4620	4500	4380	4260	4140	4020	3900	3780	3660	3540
700	Fan Speed (RPM)	1004	994	984	974	964	954	944	933.8	924	914	904	894	884	874	864	854	844
	Power Input (W)	9430	9155	8880	8605	8330	8055	7780	7505	7230	6955	6680	6405	6130	5855	5580	5305	5030
900	Fan Speed (RPM)	1013	1000	995	990	976	960	955	945	930	922	915	900	895	887	866	857	839
	Power Input (W)	10200	9688	9338	8928	8788	8488	8158	7828	7498	7168	6838	6528	6318	6228	6078	5868	5778

External Static Pressure (ESP)		Model 250/350/450/550/600/700/900 = 150Pa																
Models R410A	N	0	0.25	0.5	0.75	1	1.25	1.5	1.75	2	2.25	2.5	2.75	3	3.25	3.5	3.75	4
Rooftop	X	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5	5.5	6	6.5	7	7.5	8	8.5
250	Fan Speed (RPM)	750	744	738	733	727	721	714	708	701	693	686	678	671	664	657 (1)	650	643
	Power Input (W)	1790	1720	1645	1580	1510	1445	1375	1325	1270	1205	1130	1045	955	870	800 (1)	755	715
350	Fan Speed (RPM)	769	762	755	748	741	734	727	720	713	706	698	690	682	673 (2)	665	657	650
	Power Input (W)	2300	2205	2105	2000	1900	1800	1700	1610	1530	1460	1380	1300	1230	1160 (2)	1110	1060	1000
450	Fan Speed (RPM)	833	827	821	814	807	801	795	788	780	771	765	759	752	745	737 (3)	727	717
	Power Input (W)	3440	3330	3220	3110	3000	2890	2780	2670	2560	2450	2340	2230	2120	2020	1910 (3)	1830	1740
550	Fan Speed (RPM)	882	875	868	861	853	846	838	830	821	812	804	796	788	779	770	761	752
	Power Input (W)	5210	5050	4890	4720	4550	4400	4260	4100	3930	3770	3620	3480	3340	3190	3030	2890	2750
600	Fan Speed (RPM)	892	883	874	865	856	847	838	829	821	813	805	797	789	781	773	765	757
	Power Input (W)	5270	5160	5020	4880	4740	4600	4460	4320	4200	4080	3960	3840	3720	3600	3480	3360	3240
700	Fan Speed (RPM)	1008	998	988	978	968	958	948	937.9	928	918	908	898	888	878	868	858	848
	Power Input (W)	8910	8645	8380	8115	7850	7585	7320	7055	6790	6525	6260	5995	5730	5465	5200	4935	4670
900	Fan Speed (RPM)	1014	1005	998	990	977	963	956	946	932	924	917	907	900	888	870	858	843
	Power Input (W)	9775	9318	8968	8578	8418	8118	7798	7478	7158	6838	6518	6158	5968	5858	5708	5518	5408

External Static Pressure (ESP)		Model 250/350/450 = 200Pa, Model 550/600/700/900 = 210Pa																	
Models R410A	N	0	0.25	0.5	0.75	1	1.25	1.5	1.75	2	2.25	2.5	2.75	3	3.25	3.5	3.75	4	
Rooftop	X	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5	5.5	6	6.5	7	7.5	8	8.5	
250	Fan Speed (RPM)	763	757	751	744	738	733	727	721	715	708	700	693	685	677	669	661	653	
	Power Input (W)	1370	1320	1265	1195	1130	1065	1000	950	905	850	790	725	650	605	555	510	460	
350	Fan Speed (RPM)	776	769	762	755	748	741	733	726	718	711	703	695	687	679	671	663	655	
	Power Input (W)	1910	1830	1740	1650	1560	1470	1390	1300	1210	1140	1055	985	920	850	790	740	690	
450	Fan Speed (RPM)	842	836	830	823	817	811	805	796.2	788	781	773	764	755	746	738	731	723	
	Power Input (W)	3080	2980	2890	2780	2670	2560	2450	2340	2230	2120	2020	1910	1820	1730	1620	1520	1420	
550	Fan Speed (RPM)	889	882	875	868	861	853	845	837	828	819	810	801	792	783 (4)	774	765	757	
	Power Input (W)	4670	4520	4370	4210	4060	3900	3750	3600	3430	3260	3090	2920	2750	2580 (4)	2470	2330	2230	
600	Fan Speed (RPM)	896	887	880	873	864	855	846	836.5	828	819	811	802	793	784	778	768	759	
	Power Input (W)	4950	4710	4570	4430	4290	4150	4010	3870	3870	3730	3590	3450	3310	3170	3030	2890	2750	
700	Fan Speed (RPM)	1010	1000	990	980	970	960	950	939.7	930	920	910	900	890	880	870	860	850	
	Power Input (W)	8180	7925	7670	7415	7160	6905	6650	6395	6140	5885	5630	5375	5120	4865	4610	4355	4100	
900	Fan Speed (RPM)	1020	1007	999	992	978	965	958	948	948	935	926	919	910	905	890	871	859	847
	Power Input (W)	9350	8948	8598	8228	8048	7748	7428	7128	6828	6528	6228	5800	5618	5488	5338	5168	5038	

External Static Pressure (ESP)		250Pa																
Models R410A	N	0	0.25	0.5	0.75	1	1.25	1.5	1.75	2	2.25	2.5	2.75	3	3.25	3.5	3.75	4
Rooftop	X	0.5	1	1.5	2	2.5	3	3.5	4	4.5	5	5.5	6	6.5	7	7.5	8	8.5
550	Fan Speed (RPM)	894	887	880	871	866	857	850	841	832	826	817	808	798	790	778	773	761
	Power Input (W)	4310	4120	4050	3890	3630	3560	3370	3220	3020	2930	2780	2730	2570	2370	2210	2030	1960
600	Fan Speed (RPM)	898	893	886	877	868	859	850	841	832	823	814	805	796	787	778	769	761
	Power Input (W)	4690	4550	4410	4270	4130	3990	3850	3690	3530	3370	3210	3050	2890	2730	2570	2410	2250
700	Fan Speed (RPM)	1013	1003	993	983	973	963	953	943	932.5	923	913	908	893	883	873	863	853
	Power Input (W)	7560	7315	7070	6825	6580	6335	6090	5845	5600	5355	5110	4865	4620	4375	4130	3885	3640
900	Fan Speed (RPM)	1024	1008	1000	995	980	968	962	950	938	928	921	915	908	892	875	860	849
	Power Input (W)	8928	8578	8228	7878	7678	7378	7178	7078	7128	6828	6428	5418	5268	5118	4968	4818	4668

NOTES

- Rated = 657RPM, PI = 0.80kW
- Rated = 673RPM, PI = 1.16kW
- Rated = 737RPM, PI = 1.91kW
- Rated = 783RPM, PI = 2.58kW

LEGEND

X: Regulation Space of Motor Pulley (mm)

N: Number of Turns

ESP: External Static Pressure (mmAq)

■ : Factory Set Point

□ : Data is out of blower curve (for reference only)


13 Installation

13 - 2 Pulley

UATYQ-CY1

Motor Pulley Dimensions:

(Note: All dimensions are in mm)

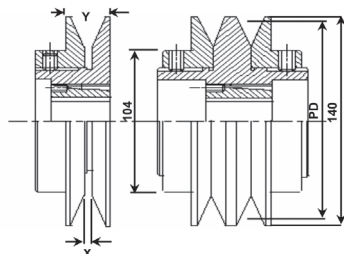


Models R410A Rooftop	Pulley Type	PD		Total Length	Quantity (pcs)
		Medium	Min - Max		
250	VPT139A1	121	109 - 133	35	1
350	VPT139A1	121	109 - 133	35	1
450	VPT139A2	121	109 - 133	70	2
550	VPT139A2	121	109 - 133	70	2
600	VPT139A2	121	109 - 133	70	2
700	VPT139A2	121	109 - 133	70	2
900	VPT139A2	121	109 - 133	70	2

Legend: PD: Pitch Diameter of Motor Pulley (mm)

V-Belt Dimensions:

(Note: All dimensions are in mm)



					Side flow		Down flow		
Models R410A Rooftop	Section	Top Width	Thickness	Angle (°)	V-belt length	Pulley center distance(mm)	V-belt length	Pulley center distance(mm)	Quantity (pcs)
						Nominal		Nominal	
250	A	12,7	10	40	1657	510	1432	425	1
350	A	12,7	10	40	1782	590	1457	430	1
450	A	12,7	10	40	1657	515	1250	345	2
550	A	12,7	10	40	1932	710	1382	420	2
600	A	12,7	10	40	1957	710	1382	420	2
700	A	12,7	10	40	1900	690	1382	440	2
900	A	12,7	10	40	1882	680	1382	445	2

Example for selection process:

The following data are the rated design points for model R410A rooftop 90:

Airflow Rate = 3300 cfm

External Static Pressure (ESP) = 150Pa

Blower RPM = 657

To increase the ESP to 200Pa, but maintain the airflow rate at 3300cfm, please follow the steps below:

Step 1: Selection of new desired point.

From the blower curve, select the point that can meet both of the requirements

(ESP = 200Pa and airflow rate = 3300cfm).

Step 2: Read RPM value from the blower curve.

Next, refer to the RPM value in the blower curve which is corresponding to this point.

For instance, from the blower curve on the right, RPM which is corresponding to this point = 727.

Step 3: Read power consumption value for indoor fan motor.

Then, use this RPM value to estimate the power consumption of indoor fan motor by referring to the table of 'Motor Variable Pitch Pulley Data'.


For instance, from the table, indoor fan motor with 727RPM consumes 1000W.

Step 4: Read number of turns for variable pitch pulley.

Similarly, use this RPM value to read the no. of turns (N) by referring to the table of 'Motor Variable Pitch Pulley Data'.

The variable pitch pulley for motor shall be adjusted to this 'N' in order to achieve the desired point (ESP = 200Pa and airflow rate = 3300cfm).

For instance, from the table, no. of turns (N) = 1.5 in order to get 727RPM. First, adjust the motor pulley to 0 turns. Then, make 1 and half turns on the pulley. Cross check the dimension 'X', which stands for regulation space of motor pulley. In this case, X = 3.5mm.

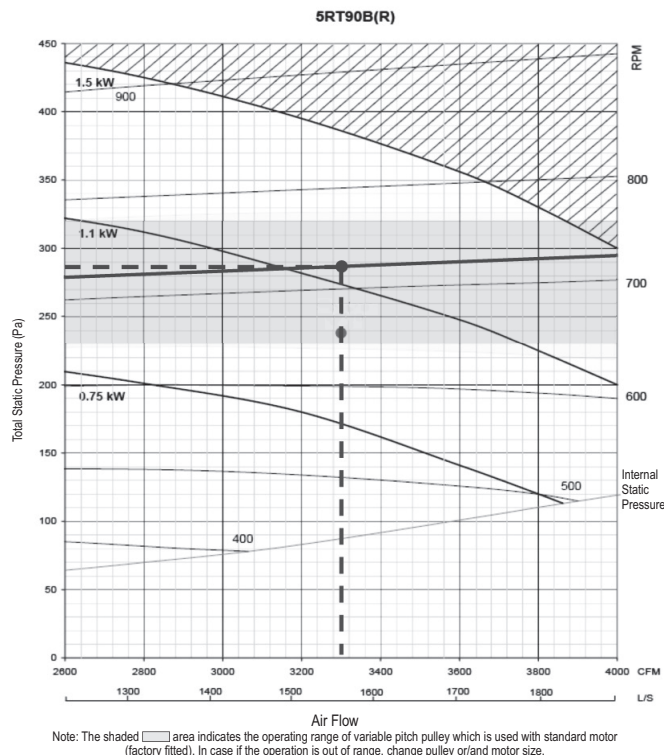


14 Operation range


14 - 1 Operation Range

UATYQ-CY1

Cooling

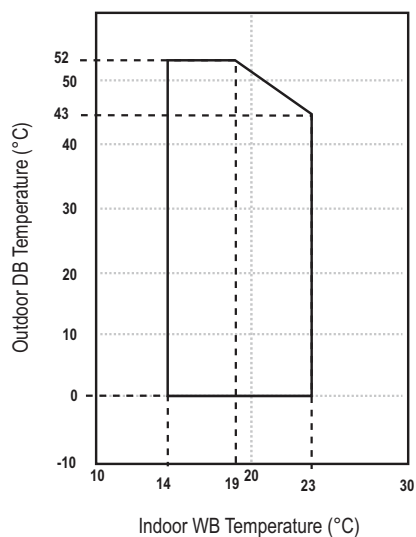

Heating

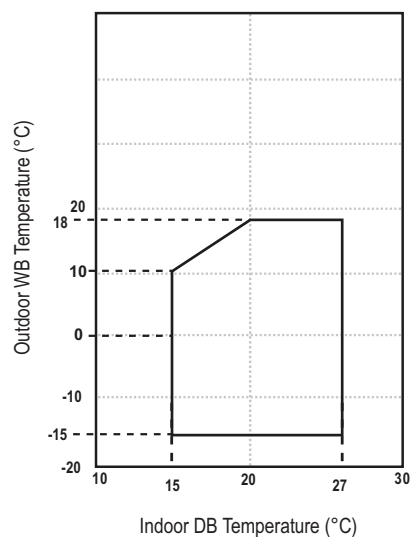

NOTE

1. The use of your air conditioner outside the range of working temperature and humidity can result in serious failure.

15 Specification text

15 - 1 Specification Text

UATYQ-CY1

15

Features Write up

1. **Package Unit:** Daikin's new range of rooftop packaged units has been developed specifically to suit commercial applications and are designed to be easy to install, requiring only ducting (and associated fittings), power/ control wiring and drain piping. Along with the light grey colour, the flat top and compact design gives an aesthetic and neat appearance when installed in line of sight. The unit cabinet is made of powder coated sheet metal especially suitable for outdoor use. All parts of the structure are fastened with corrosion resistant screws and bolts.
2. **Base Beam:** The base beams are fixed and provide a rigid foundation for the entire unit. The beam has the forklift slots and rigging holes for better handling purpose. It is also designed to allow mounting on a roof curb, the dimension of the roof curb should be followed strictly in accordance with the installation manual.
3. **Flexible Air Supply:** Since all the units utilize a belt/ pulley driven supply air fan, the units are able to meet a wide range of supply air volumes and external static pressures. Furthermore, the supply air fan motors, pulleys and belts (field supplied) can be easily changed on site to meet exact air flow and ESP requirement if required.
4. **Convertible Return and Supply Air:** Unit can be easily converted from horizontal to vertical (downward) supply and return air duct configuration by relocating the panels and supply air fan mounting.
5. **Scroll Compressor:** Units are equipped with high efficiency and reliable scroll compressors. Each compressor is mounted on rubber vibration isolators in order to reduce the noise level and vibration transmissions.
6. **Powder Coated Condensate Drain Pan:** The sheet metal condensate drain pan is powder coated to resist corrosion.
7. **Slots for 2 inches Return Air Filters:** A 2 inches rail is provided as standard in instances where a field supplied filter casement need to be installed.
8. **Higher Energy Efficiency Rating:** The UATYQ series is designed in line with market requirement for better energy saving. Its' performance is claimed to be among the best in the market.

15 Specification text

15 - 1 Specification Text

UATYQ-CY1

Technical Write Up:

1. Compressor

Compressor used in UATYQ series Packaged Units are hermetically sealed scroll type. All the compressors are provided with an internal overload protection.

2. Condenser

Condenser coils are manufactured from seamless inner grooved copper tubes mechanically bonded to aluminium fins to ensure optimum heat transfer. All coils are tested against by Nitrogen holding at 609psig and highly precise Helium leak test at 235psig. ALL standard coils are up to 3 rows / 14-16 FPI, 3/8" (9.52mm) O.D. tubes. Hydrophilic Gold Fin coating (NA549) is offered as standard, which has longer life span under corrosive environment.

3. Evaporator

Evaporator coils are manufactured from seamless inner grooved copper tubes mechanically bonded to aluminium fins to ensure optimum heat transfer. All coils are tested against by Nitrogen holding at 609psig and highly precise Helium leak test at 235psig. ALL standard coils are 3-4 rows / 14-16 FPI, 3/8" (9.52mm) O.D. tubes. Hydrophilic Gold Fin coating (NA549) is offered as standard, which has longer life span under corrosive environment.

4. Condenser Fan and Motor

Fans are of propeller type, direct driven by weatherproof electrical induction motors. Condenser fan motor has class F insulation and splash-proof enclosure, IP44.

5. Evaporator Fan and Drive

Blower is DWDI centrifugal, forward curved type. It is mechanically and dynamically balanced and being mounted on a rigid shaft in a self aligned bearing block. The motor is fitted with an adjustable V-belt drive, as standard. It has class B insulation and dripping water proof, IP22.

6. Refrigerant Circuit

Each refrigerant circuit shall have independent electronic expansion devices, HP/LP switch and refrigerant line service pressure ports as standard factory installed.

7. Expansion device:

Electronic Expansion Valve is being used to ensure accurate control of refrigerant flow.

8. Casing/ Structure

The unit casing used in UATYQ series is made of zinc coated galvanized steel sheets. It is further coated with an electrostatic powder coat and then oven-baked for a tough and lasting weather resistant finish. Zinc plated screws are used throughout to further reduce possibility of unit rusting.

15 Specification text

15 - 1 Specification Text

UATYQ-CY1

9. Insulation

ALL possible areas of condensation to happen are insulated by PE, Polyethelene. Panel insulation is 10mm thickness while drain pan insulation is 5mm thickness.

10. Control

Units shall be completely factory supplied with an integrated controlled Module, with built in resident control algorithms to make decide heating, cooling, or ventilating operations in response to electronic signals from indoor & outdoor temperature sensors.

11. Rooftop Panel - handset

Rooftop Panel comprises all starting, operating and safety controls setting. It is connected to the IC module PCB and supplied as standard.

12. Optional Features

I. 3rd Party Thermostat

For application that requires uniform thermostat outlook with other electrical appliances. 3rd Party thermostat can be connected to the factory supplied module via the contact point available on PCB board.

II. Basic BMS Connection

Unit's standard PCB board provides dry contact for basic BMS connection. Input signal will go to dry contact ON/OFF, COOL/HEAT, and 4 to 20 mA temperature adjuster while output signal will come from ON/OFF, COOL/HEAT, ALARM and DEFROST dry contact.

III. Higher Level BMS Connection

Connection to higher level BMS is possible via Daikin compatible interface, DEC101/102A55.

IV. Economizer

Field installed economizer is supplied from factory as an accessory. It is also designed to cater for horizontal or vertical down throw air discharge orientation.

V. CO2 Sensor

Field specified CO2 sensor can be easily plug on the control board's dry contact, which is come as standard.



Daikin Europe N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende



EEDEN17

03/17



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.